#### **GENERAL NOTES:**

- 1. THESE SHEETS ARE IN ACCORDANCE WITH THE AMERICANS WITH DISABILITIES ACT (ADA), AND THE REQUIREMENTS OF THE 2011 PROPOSED ACCESSIBILITY GUIDELINES FOR PEDESTRIAN FACILITIES IN THE PUBLIC RIGHT OF WAY (PROWAG).
- 2. NOT ALL FACILITIES CAN BE CONSTRUCTED TO MEET THE DESIGN STANDARDS. FACILITIES THAT CANNOT BE CONSTRUCTED TO MEET THE DESIGN STANDARDS SHALL BE CONSTRUCTED TO MEET THE STANDARDS TO THE GREATEST EXTENT PRACTICABLE. NONSTANDARD FEATURES SHALL BE DOCUMENTED ON TECHNICAL INFEASIBILITY FORM AND SUBMITTED TO NHOOT ADA COORDINATOR FOR APPROVAL.
- 3. TO CHECK FIELD LAYOUT ALL SLOPES AND GRADES SHALL BE MEASURED WITH A DIGITAL LEVEL USING AT LEAST TWO READINGS. WHERE THE READINGS VARY, THE MEASUREMENTS SHALL BE AVERAGED. GRADE (RUNNING SLOPE) SHALL BE MEASURED ALONG THE CENTERLINE AND OFFSET 1.00' TO 1.50' FROM THE CENTERLINE. CROSS SLOPES SHALL BE MEASURED PERPENDICULAR TO CENTERLINE AT 5.00' TO 10.00' INTERVALS.
- 4. GRADES (RUNNING SLOPES) ARE MEASURED IN THE DIRECTION OF PEDESTRIAN TRAVEL. CROSS SLOPES ARE MEASURED PERPENDICULAR TO THE DIRECTION OF PEDESTRIAN TRAVEL.
- 5. JOINTS BETWEEN SIDEWALKS, CURB RAMPS, TURNING SPACES AND ROADWAYS SHALL BE FLUSH AND FREE FROM ABRUPT VERTICAL CHANGES GREATER THAN 1/4". VERTICAL SURFACE DISCONTINUITIES BETWEEN 1/4" AND 1/2" SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 2:1. THE BEVEL SHALL BE APPLIED ACROSS THE ENTIRE JOINT. SEE DETAIL ON SHEET 9 OF 9.
- 6. SIDEWALKS ARE CONNECTED TO ROADWAYS BY EITHER BLENDED TRANSITIONS OR CURB RAMPS. BLENDED TRANSITIONS ARE CONNECTIONS BETWEEN THE SIDEWALK LEVEL AND THE ROADWAY LEVEL THAT HAVE A MAXIMUM GRADE (RUNNING SLOPE) OF 5%, AND TRANSITIONS GREATER THAN 5% ARE CONSIDERED CURB RAMPS.
- 7. CURB RAMPS AND BLENDED TRANSITIONS MAY REQUIRE THE INSTALLATION OF DETECTABLE WARNINGS. SEE ADDITIONAL "DETECTABLE WARNING DEVICE NOTES" ON THIS SHEET, AND DETAILS ON SHEET 6 OF 10 FOR DIMENSIONS, ORIENTATION AND INSTALLATION.
- 8. VERTICAL ALIGNMENT SHALL BE GENERALLY PLANAR. GRADE BREAKS WITHIN THE PEDESTRIAN ACCESS ROUTE SHALL BE PERPENDICULAR TO THE DIRECTION OF TRAVEL AND SHALL NOT BE ROUNDED.
- 9. THE CROSS SLOPE OF PEDESTRIAN ACCESS ROUTES (PAR) SHALL BE 2% MAXIMUM. THE FOLLOWING EXCEPTIONS ARE ALLOWED:
  - A. WHERE PEDESTRIAN CROSSINGS ARE PROVIDED AT INTERSECTIONS WITHOUT YIELD OR STOP CONTROL OR WHERE THERE IS ANY TRAFFIC SIGNAL, THE CROSS SLOPE OF A PEDESTRIAN ACCESS ROUTE CONTAINED WITHIN A CROSSING SHALL BE 5% MAXIMUM.
  - B. WHERE MIDBLOCK PEDESTRIAN CROSSINGS ARE PROVIDED, THE CROSS SLOPE OF A PEDESTRIAN ACCESS ROUTE CONTAINED WITHIN A MIDBLOCK CROSSING SHALL BE PERMITTED TO EQUAL THE STREET OR HIGHWAY GRADE.
- 10. THE MINIMUM CLEAR WIDTH FOR PEDESTRIAN ACCESS ROUTES IS 4.00', EXCLUSIVE OF THE CURB. WHEN WALKWAY WIDTHS ARE LESS THAN 5.00', 5.00' x 5.00' PASSING SPACES, OR A FEATURE OF EQUAL OR GREATER DIMENSIONS (E.G., DRIVEWAYS) THAT MEET THE SLOPE CRITERIA, SHALL BE PROVIDED AT A MAXIMUM INTERVAL OF 200'. EXISTING DRIVEWAYS AND STREET CROSSINGS MAY ALSO SERVE AS PASSING SPACES.
- 11. THE BUFFER ZONE IS A PHYSICAL DISTANCE SEPARATING THE PEDESTRIAN ACCESS ROUTE FROM THE VEHICLE TRAVELED WAY. THE BUFFER ZONE MAY BE PLANTED OR PAVED.
- 12. WHEN CROSSING DRIVEWAYS, THE WORK SHALL BE IN CONFORMANCE WITH NHDOT DRIVEWAY DETAILS SHEET. THE CROSS SLOPE ACROSS DRIVEWAYS SHALL BE 2% MAXIMUM.
- 13. FOR ACCESSIBLE PEDESTRIAN SIGNAL PUSH BUTTONS, SEE DETAILS ON SHEET 8 OF 9.
- 14. FOR RAMP COUNTER SLOPE REQUIREMENTS, SEE DETAILS ON SHEET 9 OF 9.

#### **CURB RAMP NOTES:**

- 15. THE MINIMUM WIDTH OF A CURB RAMP SHALL BE 4.00'.
- 16. THE FULL WIDTH OF THE RAMP OR LANDING SHALL BE CONTAINED WITHIN THE PAVEMENT MARKINGS AT MARKED CROSSWALKS.
- 17. CURB RAMPS ARE NOT REQUIRED IN LOCATIONS WHERE THERE IS NO ACCESSIBLE PEDESTRIAN ACCESS ROUTE. UNLESS IT IS SERVING AS A LANDING FOR A PEDESTRIAN SIGNAL.
- 18. THE GRADE (RUNNING SLOPE) OF A CURB RAMP SHALL BE A MAXIMUM OF 8.3%.
- 19. WHERE EXISTING CONDITIONS DO NOT ALLOW THE CONSTRUCTION OF A CURB RAMP WITH A GRADE (RUNNING SLOPE) OF 8.3% OR LESS, THE RAMP LENGTH SHALL NOT BE REQUIRED TO EXCEED 15.00'.
- 20. THE CROSS SLOPE OF THE CURB RAMP SHALL BE AS FLAT AS POSSIBLE AND STILL PROVIDE POSITIVE DRAINAGE. THE CROSS SLOPE OF A CURB RAMP SHALL BE 2% MAXIMUM. SEE NOTE 9 FOR EXCEPTIONS. WHERE THE EXISTING ROADWAY GRADE EXCEEDS 2%, THE CURB RAMPS MAY BE WARPED ACCORDING TO THE DETAIL ON SHEET 9 OF 9 TO TIE INTO THE ROADWAY GRADE.
- 21. RAMP SIDE TREATMENT OPTIONS ARE DETAILED ON SHEET 7 OF 9 FOR USE WITHIN THE BUFFER ZONE, WHERE A PEDESTRIAN CIRCULATION PATH CROSSES THE CURB RAMP, FLARED SIDES SHALL BE INSTALLED WITH A SLOPE OF 10% MAXIMUM. THE SLOPE OF FLARED SIDES IS MEASURED PARALLEL TO THE CURB LINE. (ALSO SEE CURB RAMP CONFIGURATION TYPE 7 ON SHEET 3 OF 9).
- 22. THE BACKSIDE OF A PARALLEL RAMP SHOULD BE GRADED TO MATCH EXISTING TERRAIN.
  UNLESS OTHERWISE SHOWN IN THE CONTRACT DOCUMENTS. WHERE GRADING IS NOT FEASIBLE
  DUE TO LIMITED ROW OR PHYSICAL CONSTRAINTS, A BACK CURB MAY BE INSTALLED. SEE
  DETAILS ON SHEET 7 OF 9.

#### TURNING SPACE AND CLEAR SPACE NOTES:

- 23. WHERE A CHANGE IN DIRECTION IS REQUIRED TO UTILIZE A CURB RAMP, A TURNING SPACE SHALL BE PROVIDED AT THE BASE AND/OR THE TOP OF CURB RAMP AS APPLICABLE. TURNING SPACES SHALL BE PERMITTED TO OVERLAP CLEAR SPACES.
- 24. WHERE THERE ARE NO VERTICAL CONSTRAINTS AT THE BACK OF SIDEWALK, (E.G., VERTICAL CURB, BUILDINGS, FENCES) THE TURNING SPACE DIMENSIONS SHALL BE 4.00' X 4.00' MINIMUM. WHERE THE TURNING SPACE IS CONSTRAINED AT THE BACK OF THE SIDEWALK, THE TURNING SPACE SHALL BE 4.00' X 5.00' MINIMUM. THE 5.00' DIMENSION SHALL BE PROVIDED PERPENDICULAR TO THE CONSTRAINT.
- 25. TURNING SPACE MAXIMUM CROSS SLOPE IS 2% IN AN DIRECTION.
- 26. BEYOND THE BOTTOM GRADE BREAK, A CLEAR SPACE OF 4.00' X 4.00' MINIMUM SHALL BE PROVIDED WITHIN THE WIDTH OF THE PEDESTRIAN CROSSWALK, AND OUTSIDE THE PARALLEL VEHICLE TRAVEL LANE. THE CLEAR SPACE MAY OVERLAP TURNING SPACES, DETECTABLE WARNING SURFACES, AND DROP CURBS.

#### DETECTABLE WARNING DEVICE NOTES:

- 27. DETECTABLE WARNING DEVICES (DWD) SHALL BE PROVIDED AT THE FOLLOWING LOCATIONS OF PEDESTRIAN ACCESS ROUTES:
  - A. CURB RAMPS AT PEDESTRIAN CROSSINGS.
  - B. PEDESTRIAN REFUGE ISLANDS (WHERE THE LENGTH OF THE PEDESTRIAN ACCESS ROUTE ACROSS THE REFUGE ISLAND IS GREATER THAN OR EQUAL TO 6.00'). SEE SHEET 8 OF 9
  - C. PEDESTRIAN AT-GRADE RAIL CROSSING NOT LOCATED WITHIN A STREET OR HIGHWAY.
  - D. DRIVEWAY CROSSINGS WITH NHDOT APPROVED AND MAINTAINED SIGNALS, YIELD OR STOP CONTROL. DETECTABLE WARNING DEVICES SHALL NOT BE PROVIDED AT CROSSINGS OF UNCONTROLLED DRIVEWAY APRONS.
- 28. SOME DETECTABLE WARNING PRODUCTS REQUIRE A CONCRETE BORDER FOR PROPER INSTALLATION. IF REQUIRED, THE BORDER SHALL NOT EXCEED 2" IN WIDTH OR 6" ALONG ROADWAY EDGE/CURB. THE BORDER DIMENSIONS SHALL BE MEASURED FROM THE INSIDE EDGE OF THE RADIUS.
- 29. THE DETAILS PROVIDED ARE NOT DRAWN TO SCALE. THE QUANTITY OF DOMES DEPICTED ON THE DETECTABLE WARNING DEVICE DETAIL IS FOR ILLUSTRATION ONLY. THE SIZE OF THE DETECTABLE WARNING FIELD SHALL BE 2.00' MINIMUM IN THE DIRECTION OF TRAVEL AND SHALL EXTEND THE FULL WIDTH OF THE CURB RAMP OR FLUSH SURFACE, EXCLUDING ANY FLARED SIDES. THE WIDTH OF THE DETECTABLE WARNING FIELD INCLUDES A CONCRETE BORDER, IF PROVIDED. PLACEMENT AND ORIENTATION SHALL BE IN COMPLIANCE WITH THE DETAILS.
- 30. ON SLOPES OF 5% OR GREATER, THE ROWS OF DOMES SHALL BE ALIGNED TO BE PERPENDICULAR OR RADIAL TO THE LOWER GRADE BREAK ON THE RAMP RUN. WHERE DOMES ARE ARRAYED RADIALLY THEY MAY DIFFER IN DOME DIAMETER AND CENTER-TO-CENTER SPACING WITHIN THE RANGES SPECIFIED ON SHEET 9. ON SLOPES LESS THEN 5%, DOME ORIENTATION IS LESS CRITICAL AND MAY DIFFER FROM PERPENDICULAR OR RADIAL ALIGNMENT TO THE GRADE BREAK.
- 31. THE DETECTABLE WARNING SURFACES SHALL CONTRAST VISUALLY WITH ADJACENT GUTTER, STREET OR HIGHWAY, OR PEDESTRIAN ACCESS ROUTE SURFACE.
- 32. DETECTABLE WARNING PANELS SHALL BE CAST IRON WITH NO SURFACE COATING AND SHALL BE ALLOWED TO TRANSITION TO THEIR NATURAL PATINA.

#### **DEFINITION OF TERMS:**

LANDING: A 4.00' X 4.00' CLEAR SPACE WITH A 2% SLOPE OR LESS IN ALL DIRECTIONS.


MAXIMUM EXTENT FEASIBLE: ALL CHANGES THAT ARE POSSIBLE ARE MADE TO COMPLY WITH ACCESSIBILITY STANDARDS.

PEDESTRIAN ACCESS ROUTE (PAR): A CONTINUOUS AND UNOBSTRUCTED PATH OF TRAVEL PROVIDED FOR PEDESTRIANS WITH DISABLITIES WITHIN OR CONINCIDING WITH A PEDESTRIAN CIRCULATION PATH. PAR SHALL BE 4'W MIN.(EXCLUDING CURBING), 2% MAX. CROSS SLOPE AND 1/4" OR LESS VERTICAL DISCONTINUITY.

TECHNICAL INFEASIBILITY: EXISTING PHYSICAL OR SITE CONSTRAINTS THAT PROHIBIT MODIFICATIONS OR ADDITIONS OF ELEMENTS, SPACES OR FEATURES TO COMPLY WITH MINIMUM ACCESSIBILITY REQUIREMENTS.

#### INDEX OF SHEETS

- 1 OF 9 INDEX OF SHEETS AND GENERAL NOTES
- 2 OF 9 CURB RAMP CONFIGURATIONS TYPE 1 5
- 3 OF 9 CURB RAMP CONFIGURATIONS TYPE 6 7 4 OF 9 CURB RAMP CONFIGURATIONS TYPE 8 - 11
- 5 OF 9 SLIP RAMP, SIDEWALK TO SHOULDER TRANSISTION, ACCESS ISLAND
- 6 OF 9 DETECTABLE WARNING DEVICE PLACEMENT OPTIONS
- 7 OF 9 RAMP SIDE CONFIGURATIONS AND BACK TREATMENTS
- 8 OF 9 RR X-INGS, ROUNDABOUTS, PEDESTRIAN BUTTONS
- 9 OF 9 DETECTABLE WARNING DEVICE, TRUNCATED DOMES, MISCELLANEOUS DETAILS

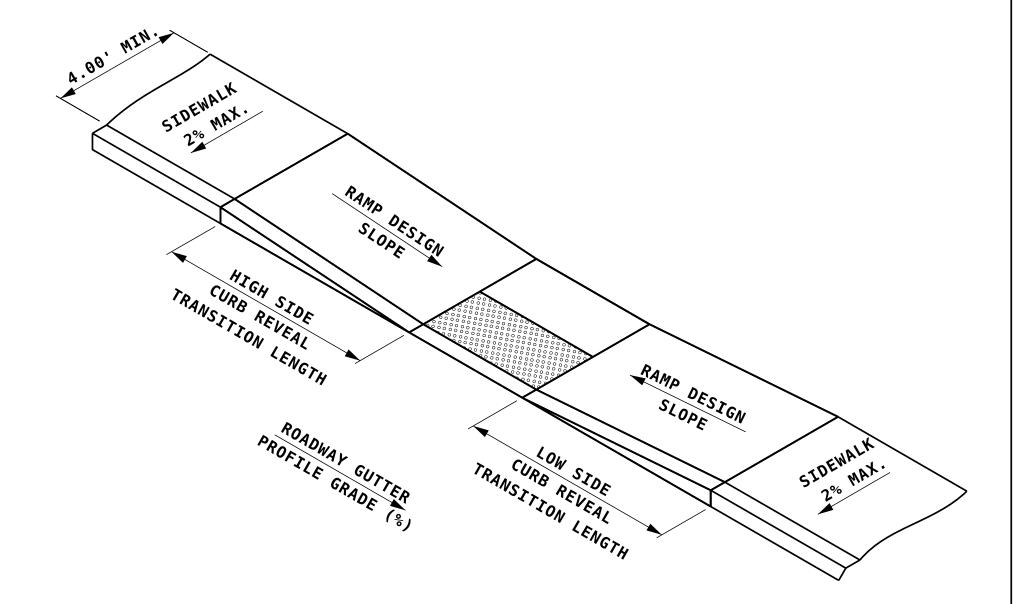

TYPICAL CURB TRANSITION LENGTH TABLE									
CURB REVEAL	(INCHES)	7	6	5	4	3	2	1	
ROADWAY PROFILE GRADE (%)		Minimum Transition Length Required (FT)							
	-10%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	-9%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	-8%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	-7%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	-6%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
Low Side Transition Length	-5%	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	- 4%	5.1	5.0	5.0	5.0	5.0	5.0	5.0	
	-3%	5.6	5.0	5.0	5.0	5.0	5.0	5.0	
	-2%	6.1	5.3	5.0	5.0	5.0	5.0	5.0	
	-1%	6.9	5.9	5.0	5.0	5.0	5.0	5.0	
	0%	7.8	6.7	5.6	5.0	5.0	5.0	5.0	
	1%	9.0	7.7	6.4	5.1	5.0	5.0	5.0	
	2%	10.6	9.1	7.6	6.1	5.0	5.0	5.0	
	3%	13.0	11.1	9.3	7.4	5.6	5.0	5.0	
	4%	15.0	14.3	11.9	9.5	7.1	5.0	5.0	
High Side Transition	5%	15.0	15.0	15.0	13.3	10.0	6.8	5.0	
Length	6%	15.0	15.0	15.0	15.0	15.0	11.3	5.3	
	7%	15.0	15.0	15.0	15.0	15.0	15.0	15.0	
	8%	15.0	15.0	15.0	15.0	15.0	15.0	15.0	
	9%	15.0	15.0	15.0	15.0	15.0	15.0	15.0	
	10%	15.0	15.0	15.0	15.0	15.0	15.0	15.0	

THIS TABLE REPRESENTS THE MINIMUM LENGTH OF CURB RAMP TRANSITION BASED ON THE EXISTING ROADWAY PROFILE GRADE AND THE CURB REVEAL AT FULL HEIGHT ALONG THE SIDEWALK. THE MINIMUM TRANSITION LENGTH REQUIRED IS BASED ON 7.5% SLOPE AND INDICATED CURB REVEAL.

### TREATMENT KEY LEGEND

(RESURFACING STYLE PROJECTS)

#-#-\$-\$

RAMP BACK TREATMENT OPTION - SEE SHEET 7

RAMP SIDE CONFIGURATION - SEE SHEET 7

DETECTABLE WARNING DEVICE PLACEMENT - SEE SHEET 6


RAMP CONFIGURATION TYPE - SEE SHEETS 2-5

(X = OMIT THIS OPTION)


STATE OF NEW HAMPSHIRE  SPECIAL DETAILS					
DEPARTMENT OF TRANSPORTATION	0	BUREAU OF HIGHWAY DESIGN			

SIDEWALK CURB RAMP DETAILS (SHEET 1 OF 9)

REVISION DATE DGN STATE PROJECT NO. SHEET NO. TOTAL SHEETS curb-ramp-1 [Sheet] 09-26-2023 curb-ramp-1-9-ce - 1 9

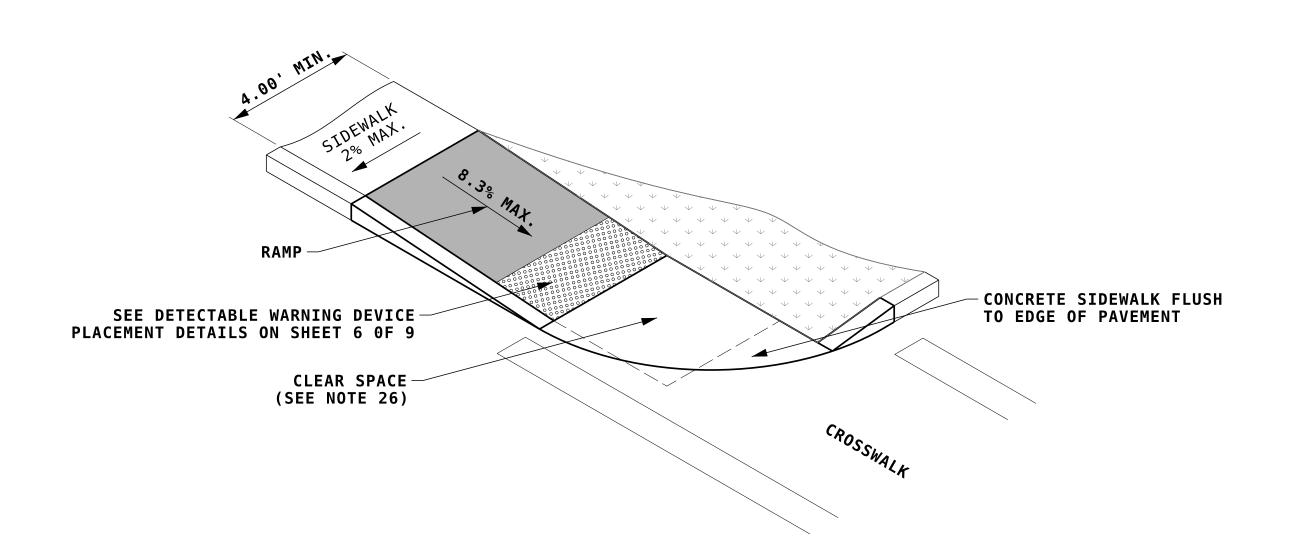


TYPE 1

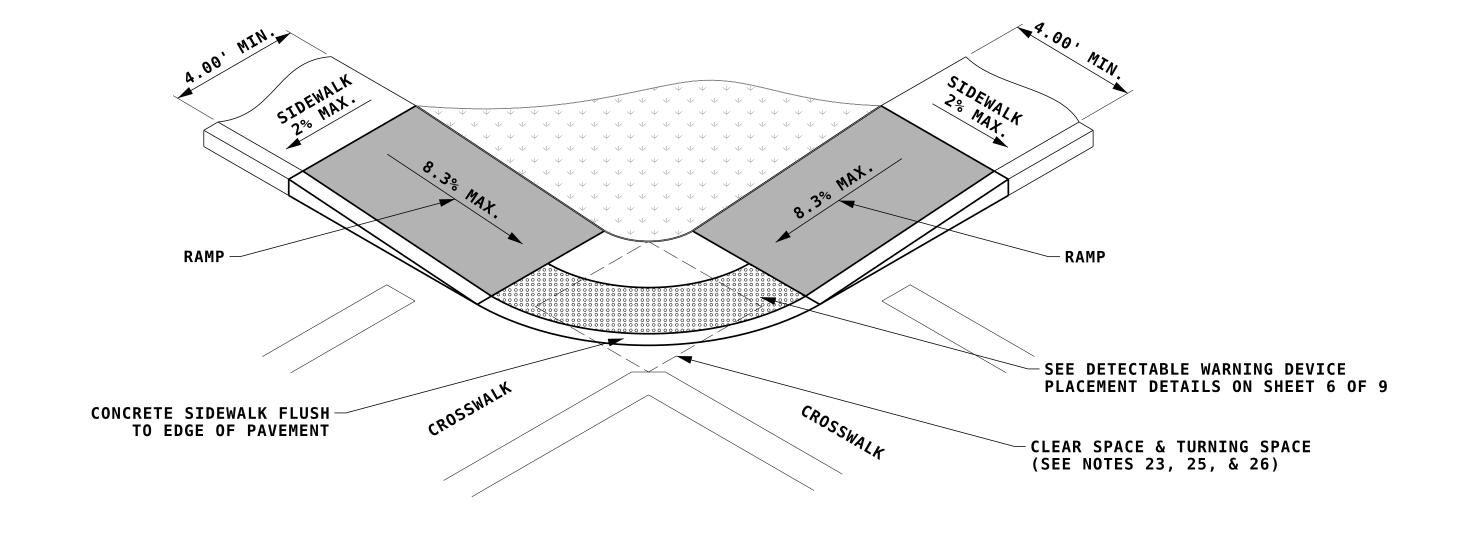


TYPE 4


NOT FOR NEW DESIGNS - RETROFITS ONLY

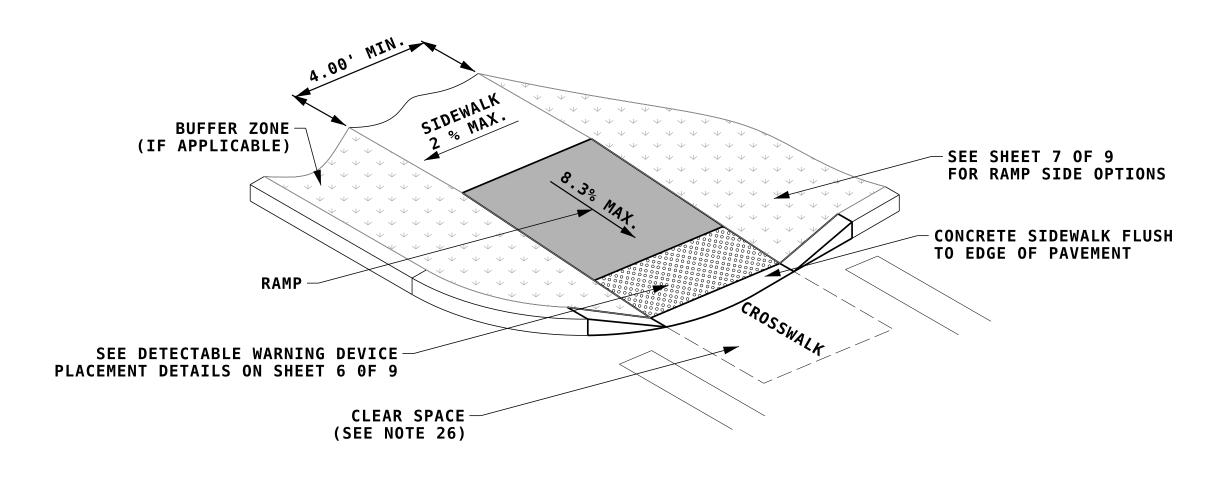

TYPE 2

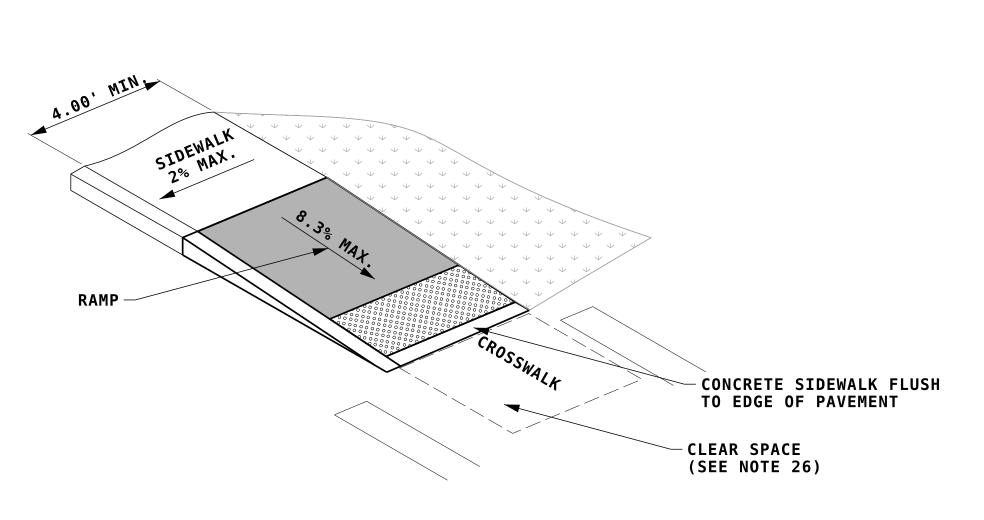

1176

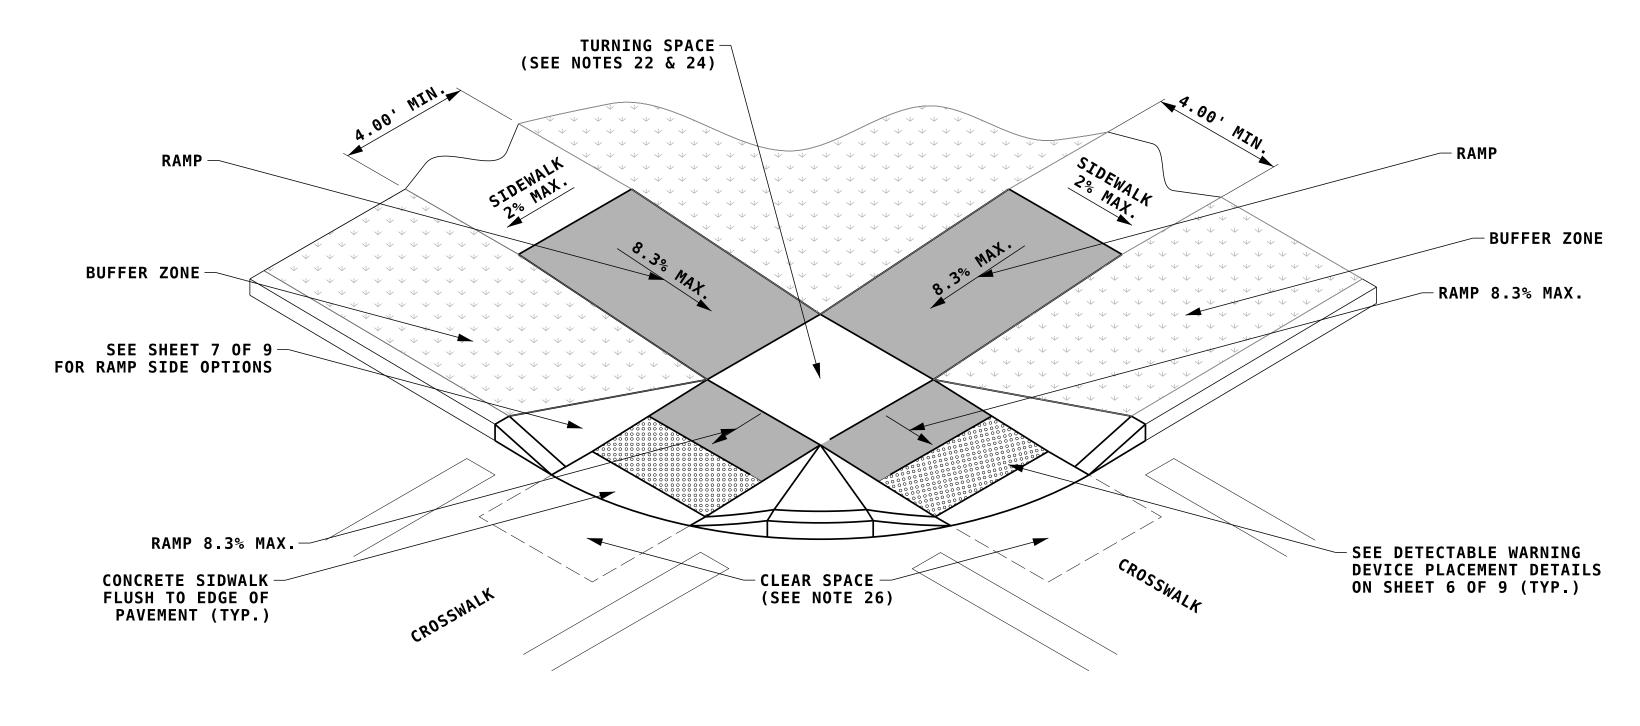

TYPE 5

## TYPE 3

## CURB RAMP CONFIGURATIONS


#### 

#### SIDEWALK CURB RAMP DETAILS (SHEET 2 OF 9)


REVISION DATE DGN STATE PROJECT NO. SHEET NO. TOTAL SHEETS

Curb-ramp-2 [Sheet] 09-26-2023 curb-ramp-1-9-ce - 2 9

ALL NOTES REFERENCED ON THIS SHEET CAN BE FOUND ON SIDEWALK CURB RAMP DETAILS, SHEET 1 OF 9.

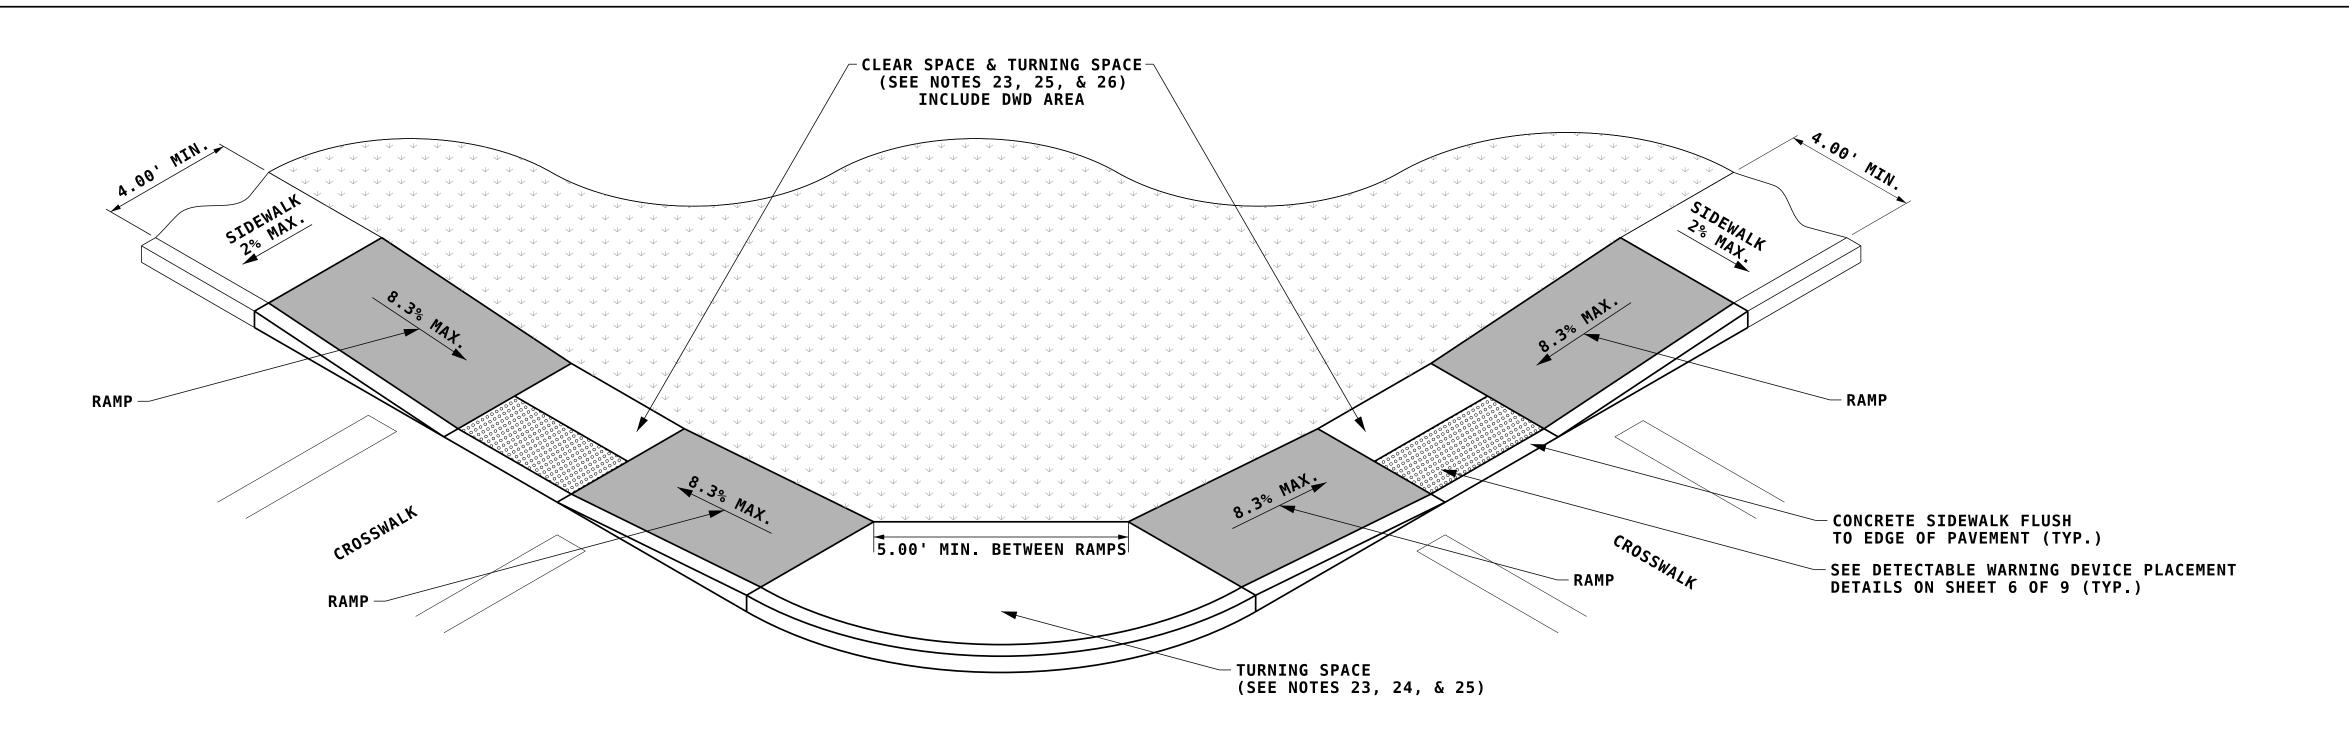

#### TYPE 6

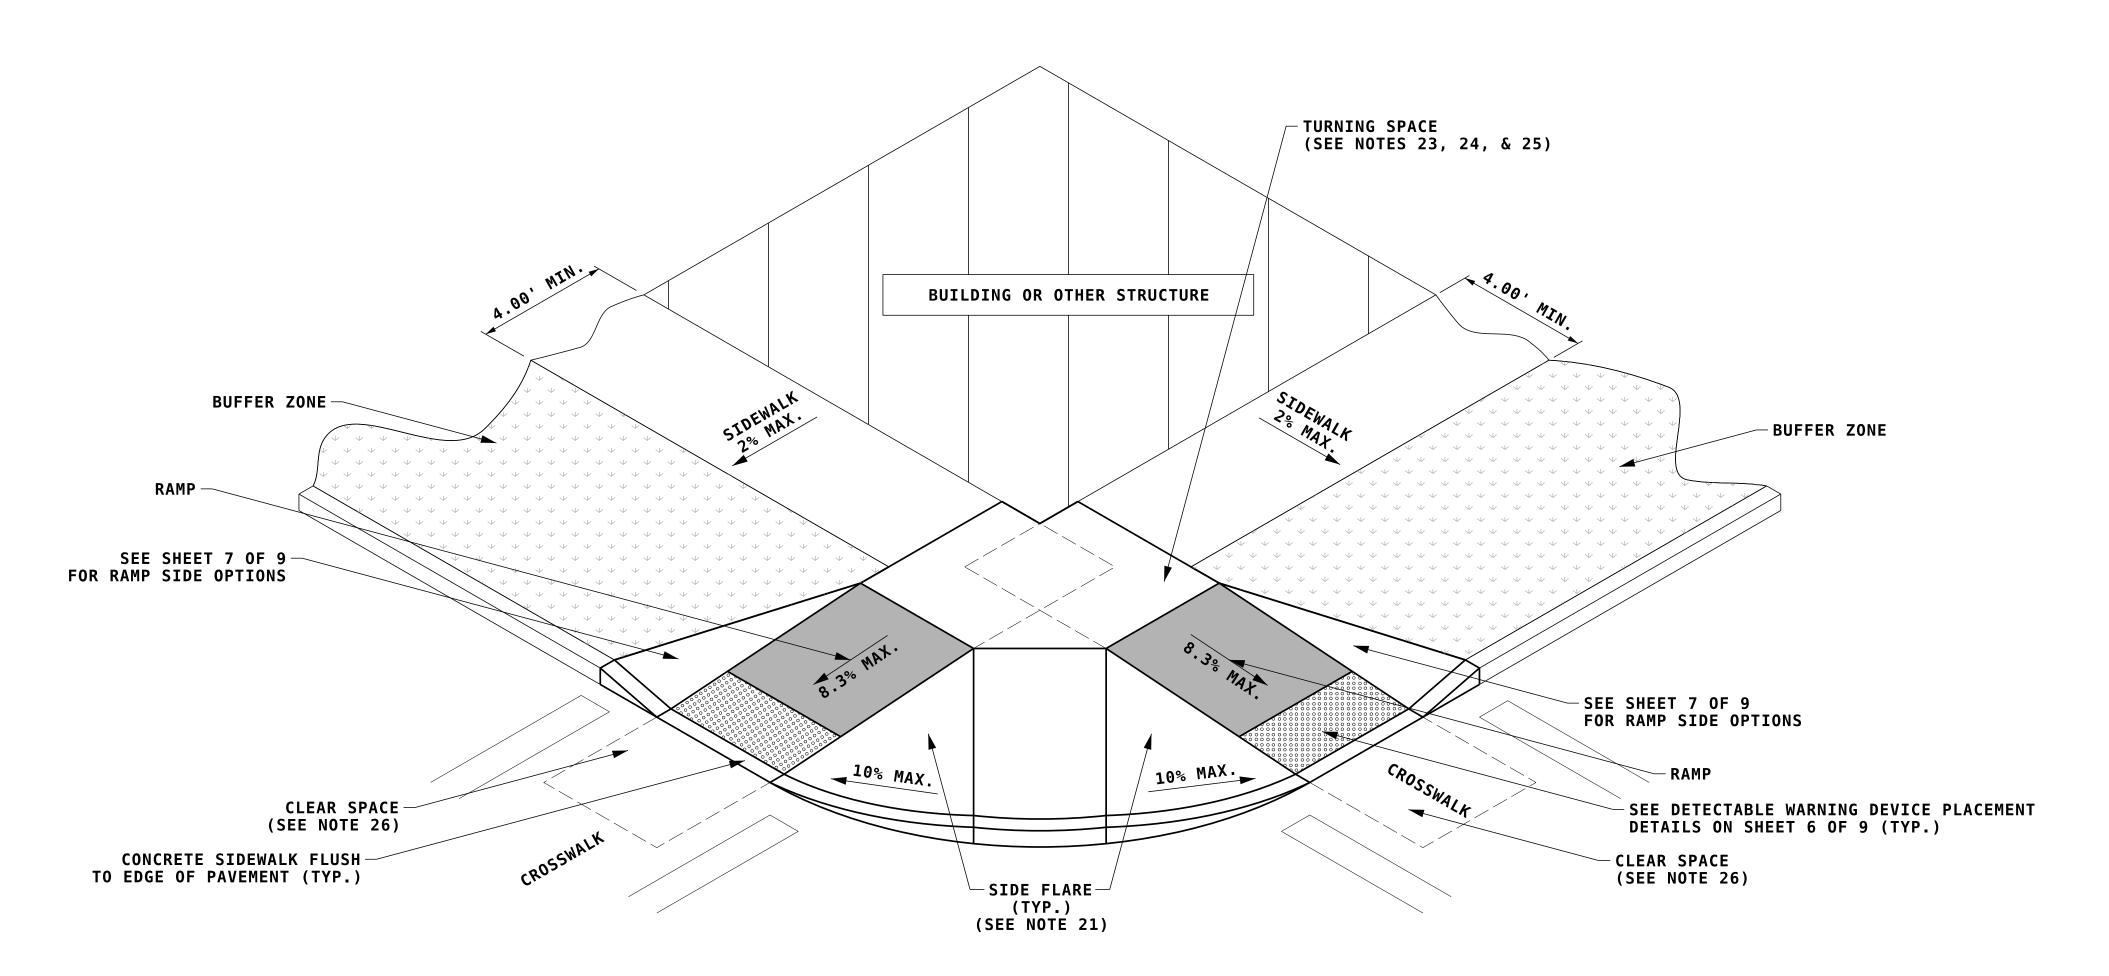


TYPE 7

## CURB RAMP CONFIGURATIONS

## STATE OF NEW HAMPSHIRE SPECIAL DETAILS

DEPARTMENT OF TRANSPORTATION • BUREAU OF HIGHWAY DESIGN

#### SIDEWALK CURB RAMP DETAILS (SHEET 3 OF 9)

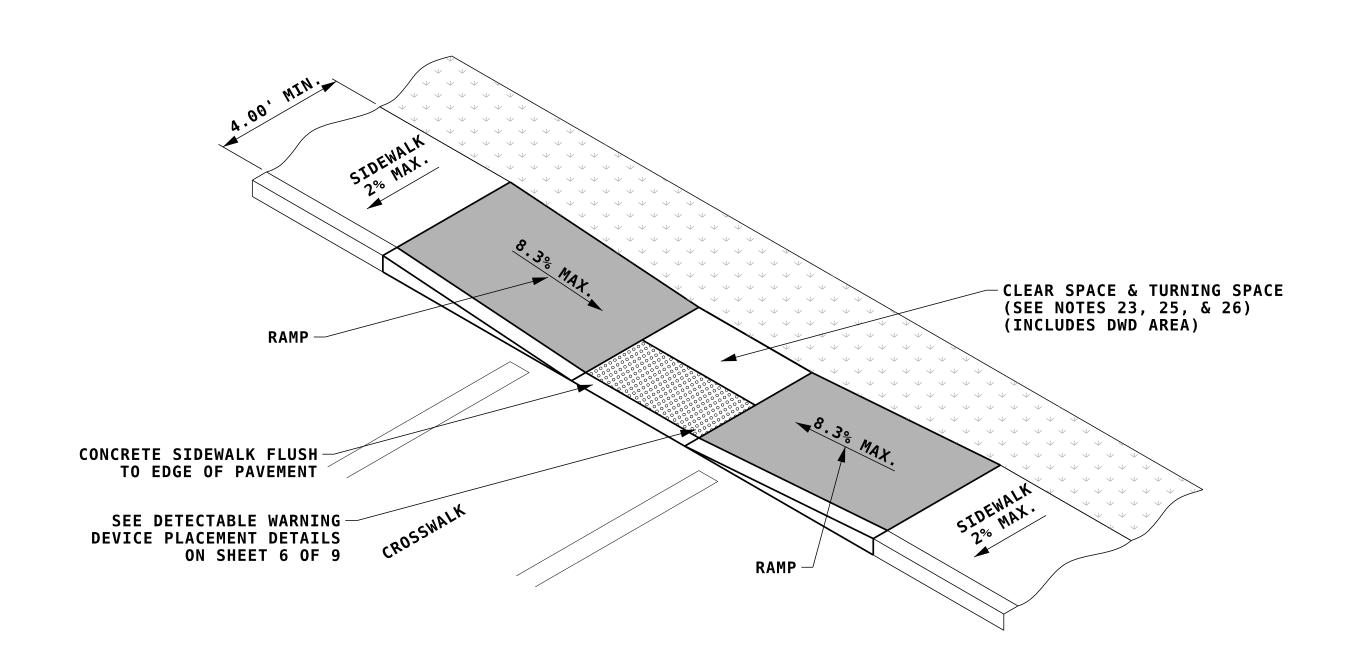


BUFFER ZONE TURNING SPACE -(SEE NOTES 23 & 25) SEE DETECTABLE WARNING
DEVICE PLACEMENT DETAILS
ON SHEET 6 OF 9 -CLEAR SPACE (SEE NOTE 26) BUFFER ZONE - CONCRETE SIDEWALK FLUSH TO EDGE OF PAVEMENT RAMP -

TYPE 8 MID BLOCK CROSSING OR T INTERSECTION

BUFFER ZONE -RAMP 8.3% MAX. - SEE DETECTABLE WARNING DEVICE PLACEMENT DETAILS ON SHEET 6 OF 9 - CONCRETE SIDEWALK FLUSH TO EDGE OF PAVEMENT

TYPE 10 MID BLOCK CROSSING OR T INTERSECTION

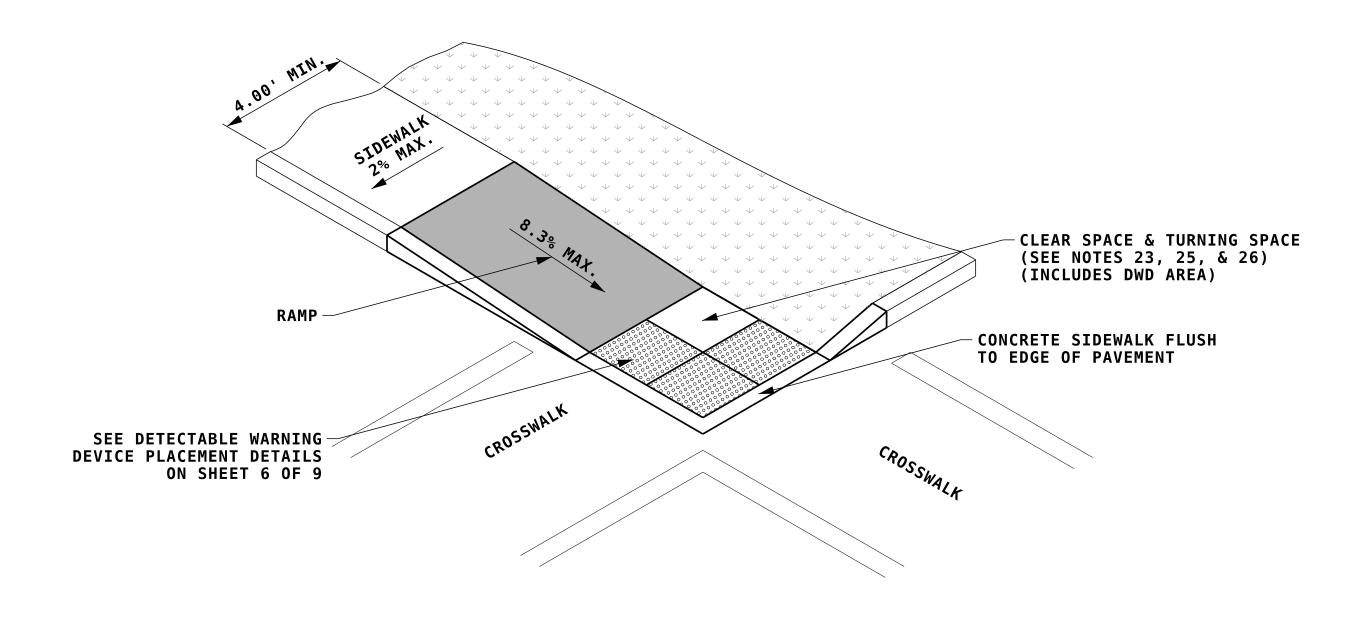

TYPE 9 MID BLOCK CROSSING OR T INTERSECTION

CLEAR SPACE— (SEE NOTE 26)

CURB RAMP CONFIGURATIONS

#### TYPE 11

STATE OF NEW HAMPSHIRE  SPECIAL DETAILS				
DEPARTMENT OF TRANSPORTATION	0	BUREAU OF HIGHWAY DESIGN		


#### SIDEWALK CURB RAMP DETAILS (SHEET 4 OF 9)


STATE PROJECT NO. | SHEET NO. | TOTAL SHEETS REVISION DATE curb-ramp-4 [Sheet] | 09-26-2023 | curb-ramp-1-9-ce

ALL NOTES REFERENCED ON THIS SHEET CAN BE FOUND ON SIDEWALK CURB RAMP DETAILS, SHEET 1 OF 9.


TURNING SPACE - (SEE NOTES 23 & 25)

**BUFFER ZONE** 

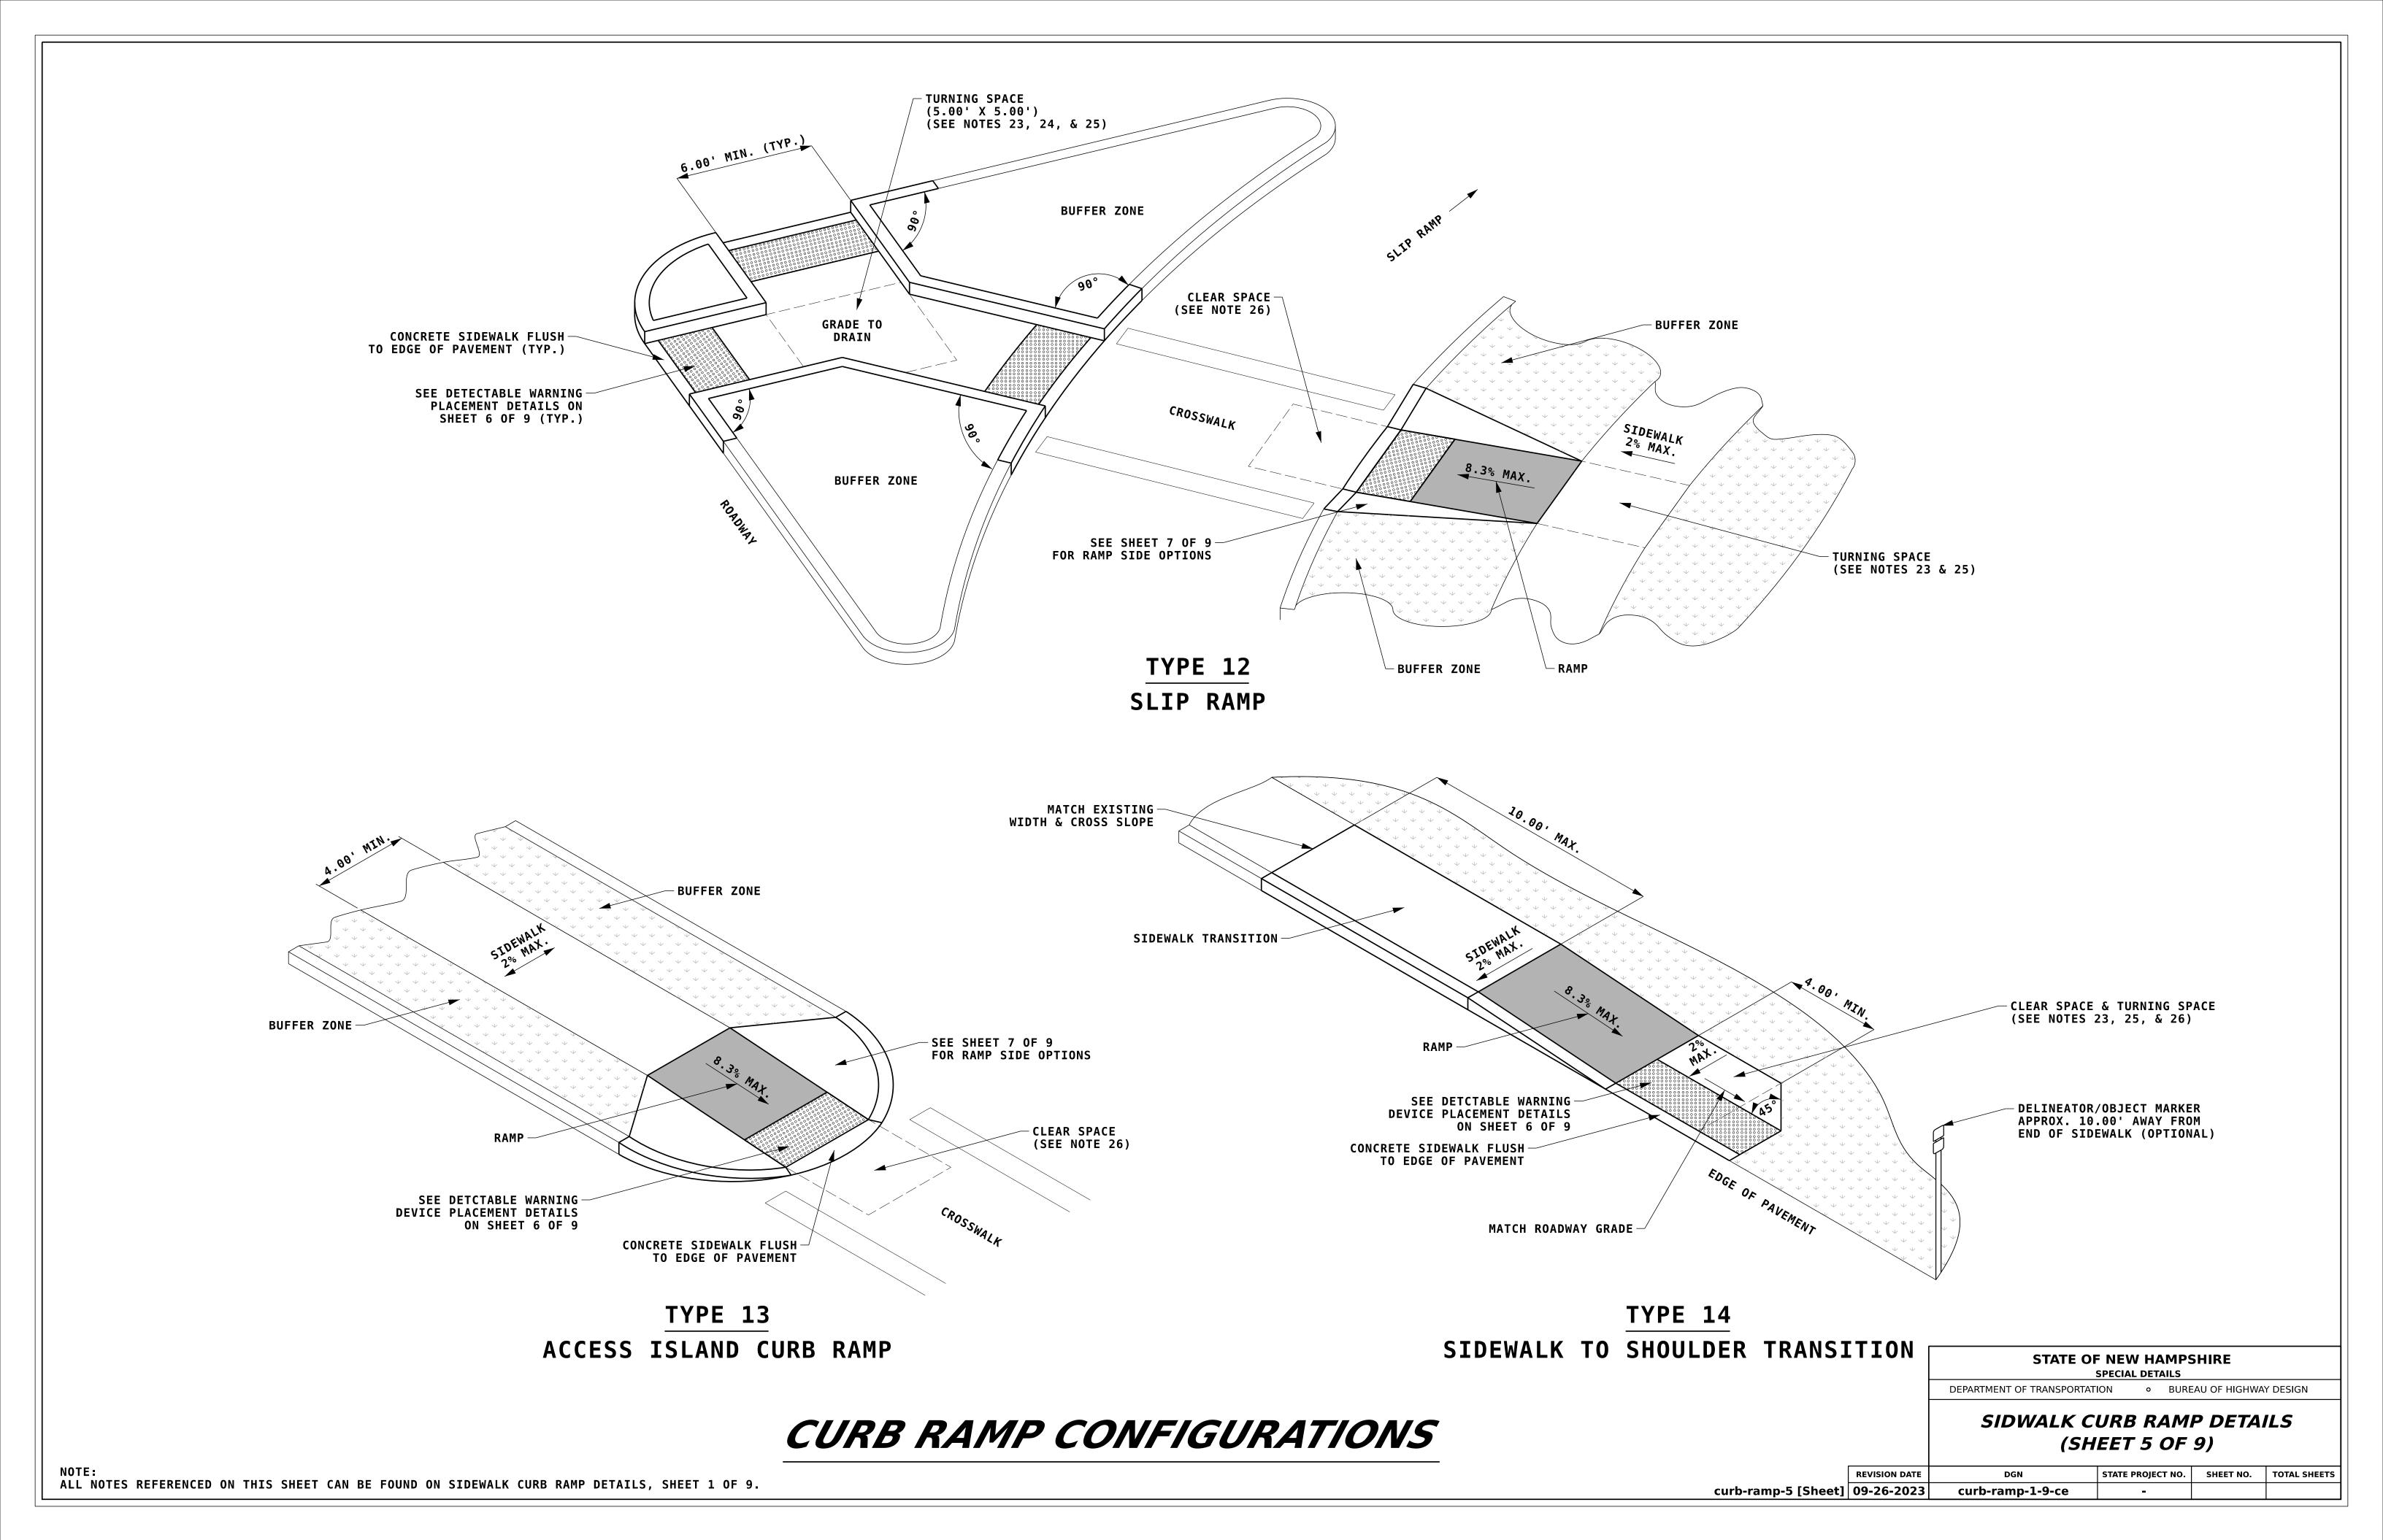

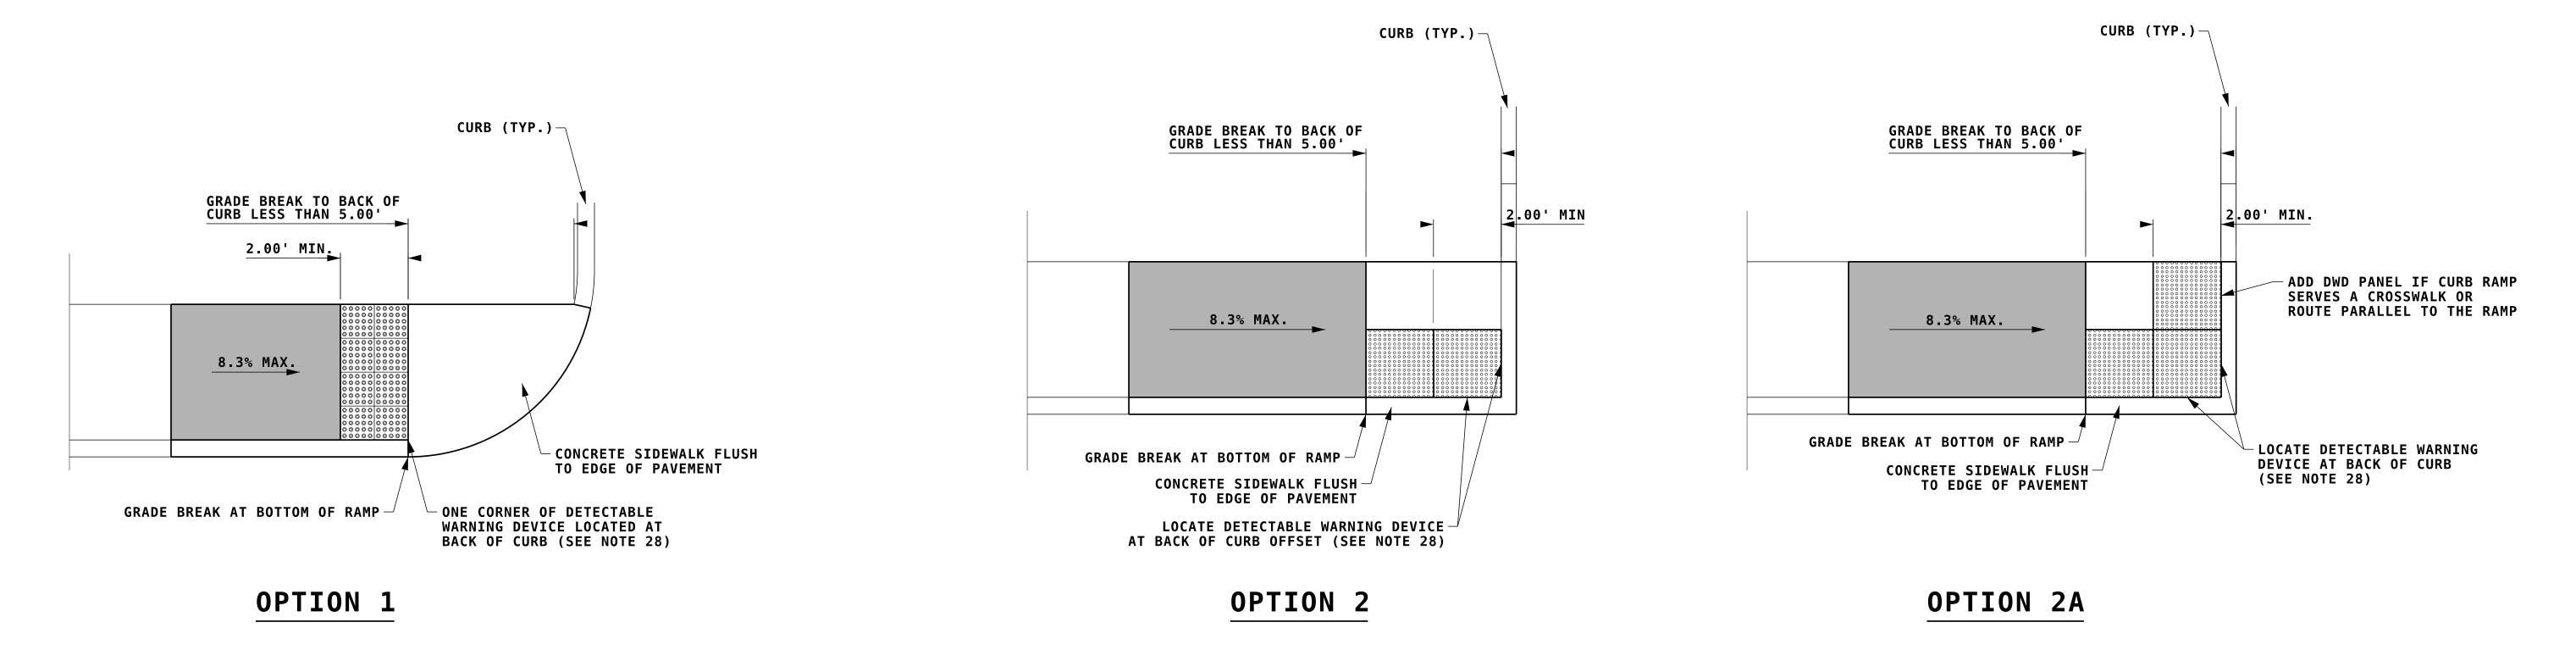

### GRADE BREAK TO BACK OF CURB LESS THAN 5.00'

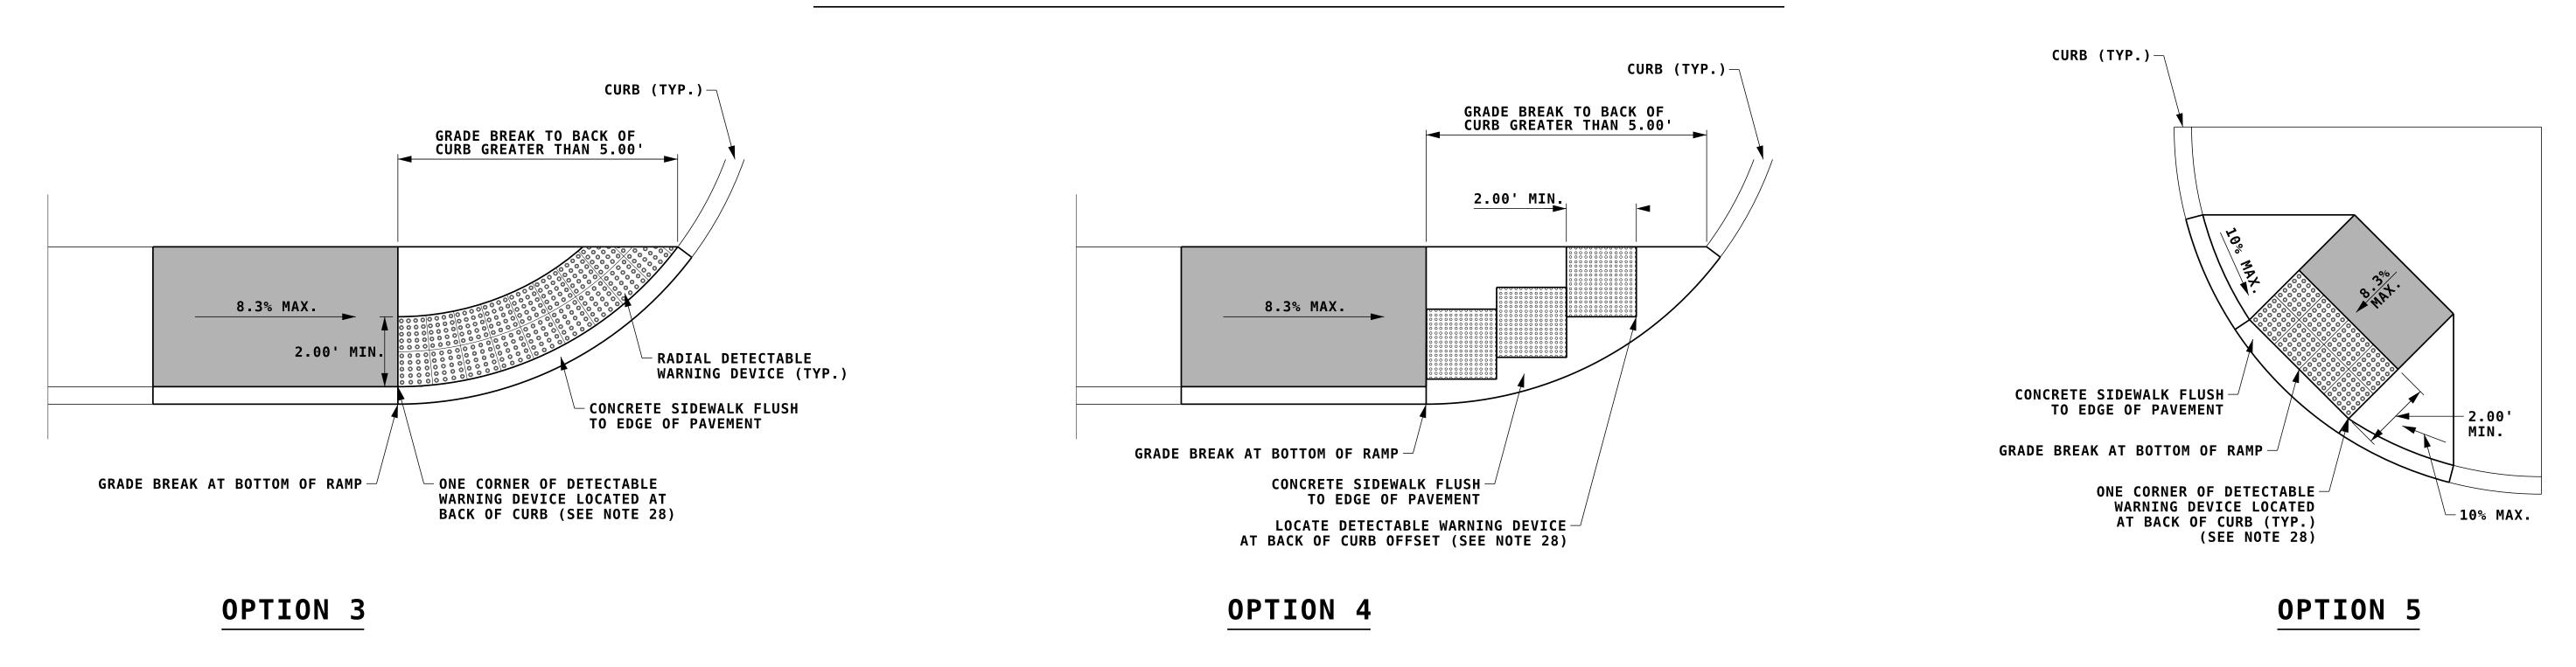

## GRADE BREAK TO BACK OF CURB GREATER THAN 5.00'

## DETECTABLE WARNING DEVICE (DWD) PLACEMENT OPTION DETAILS

SPECIAL DETAILS				
DEPARTMENT OF TRANSPORTATION	0	BUREAU OF HIGHWAY DESIGN		
SIDEWALK CUR (SHEET				


**STATE OF NEW HAMPSHIRE** 

NOTE: ALL NOTES REFERENCED ON THIS SHEET CAN BE FOUND ON SIDEWALK CURB RAMP DETAILS, SHEET 1 OF 9.

curb-ramp-6 [Sheet] REVISION DATE DG
curb-ramp-6 [Sheet] 09-26-2023 curb-ram

DGN STATE PROJECT NO. SHEET NO. TOTAL SHEETS

CUrb-ramp-1-9-ce - 6 9

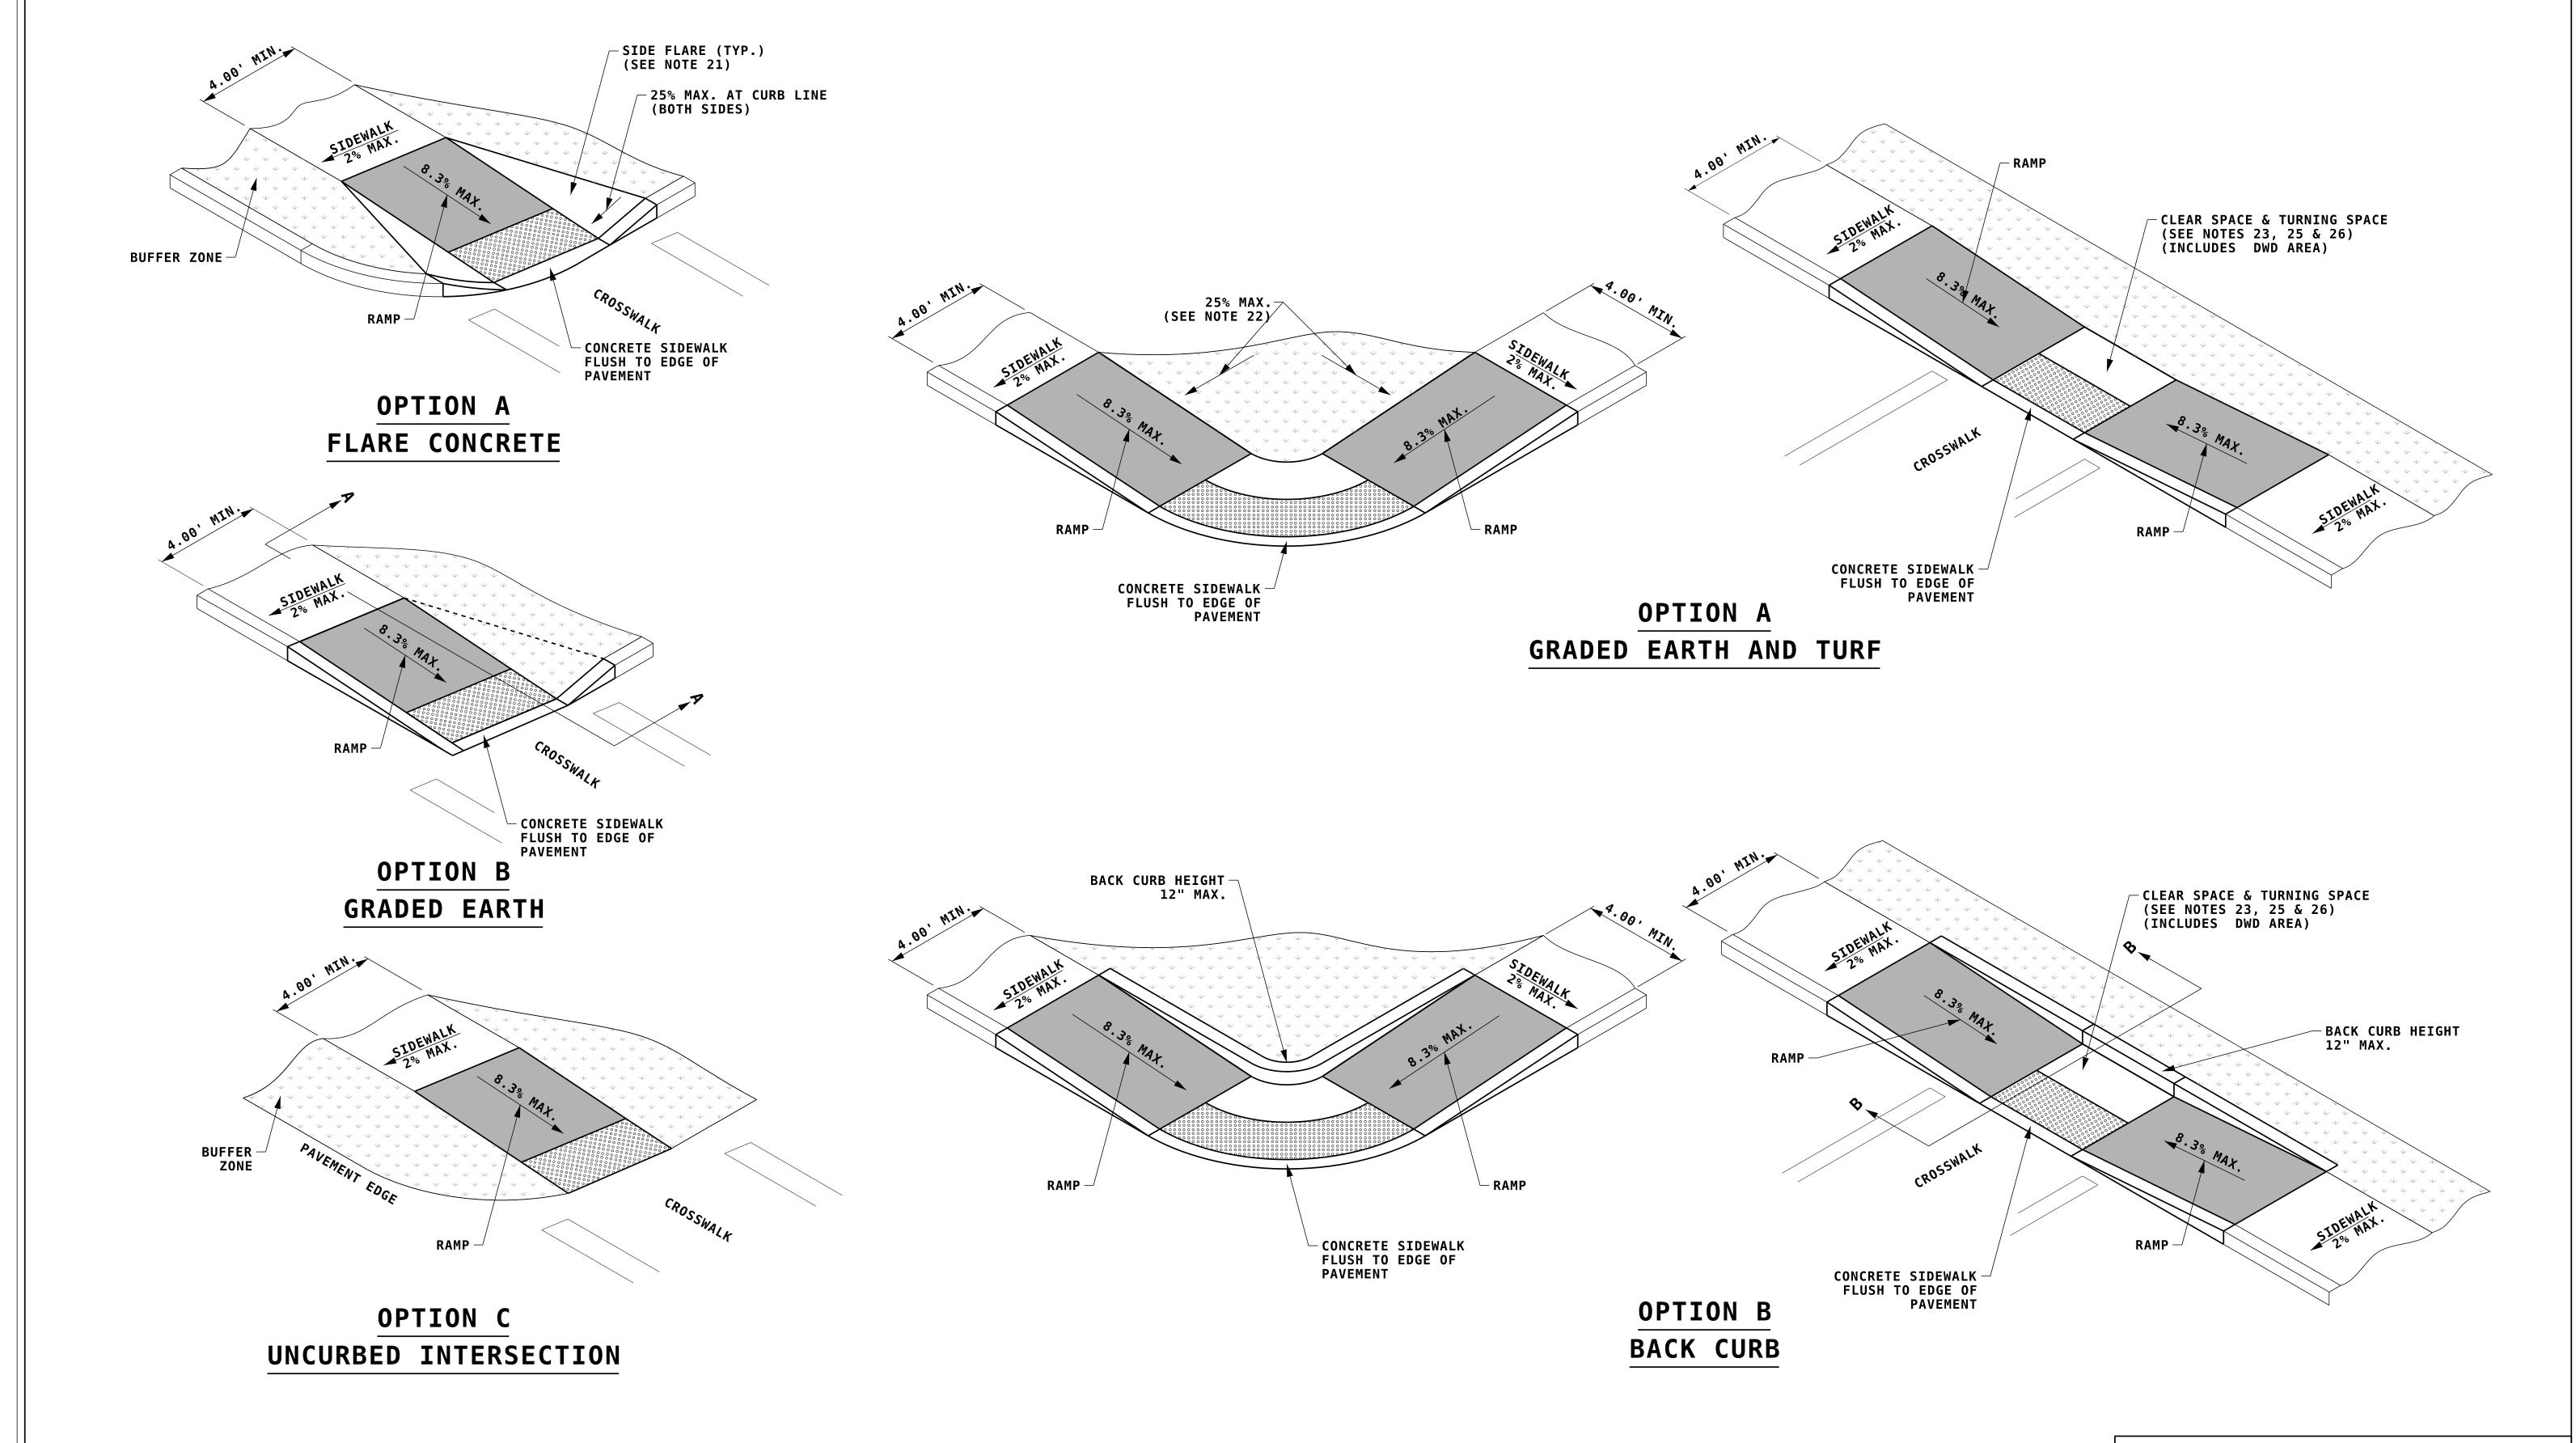


RAMP SIDE CONFIGURATIONS


## RAMP BACK TREATMENTS

STATE OF NEW HAMPSHIRE  SPECIAL DETAILS						
DEPARTMENT OF TRANSPORTATION • BUREAU OF HIGHWAY DESIGN						


SIDEWALK CURB RAMP DETAILS (SHEET 7 OF 9)

NOTE: ALL NOTES REFERENCED ON THIS SHEET CAN BE FOUND ON SIDEWALK CURB RAMP DETAILS, SHEET 1 OF 9. revision date dgn state project no. sheet no. total sheets curb-ramp-7 [Sheet] 09-26-2023 curb-ramp-1-9-ce - 7 9

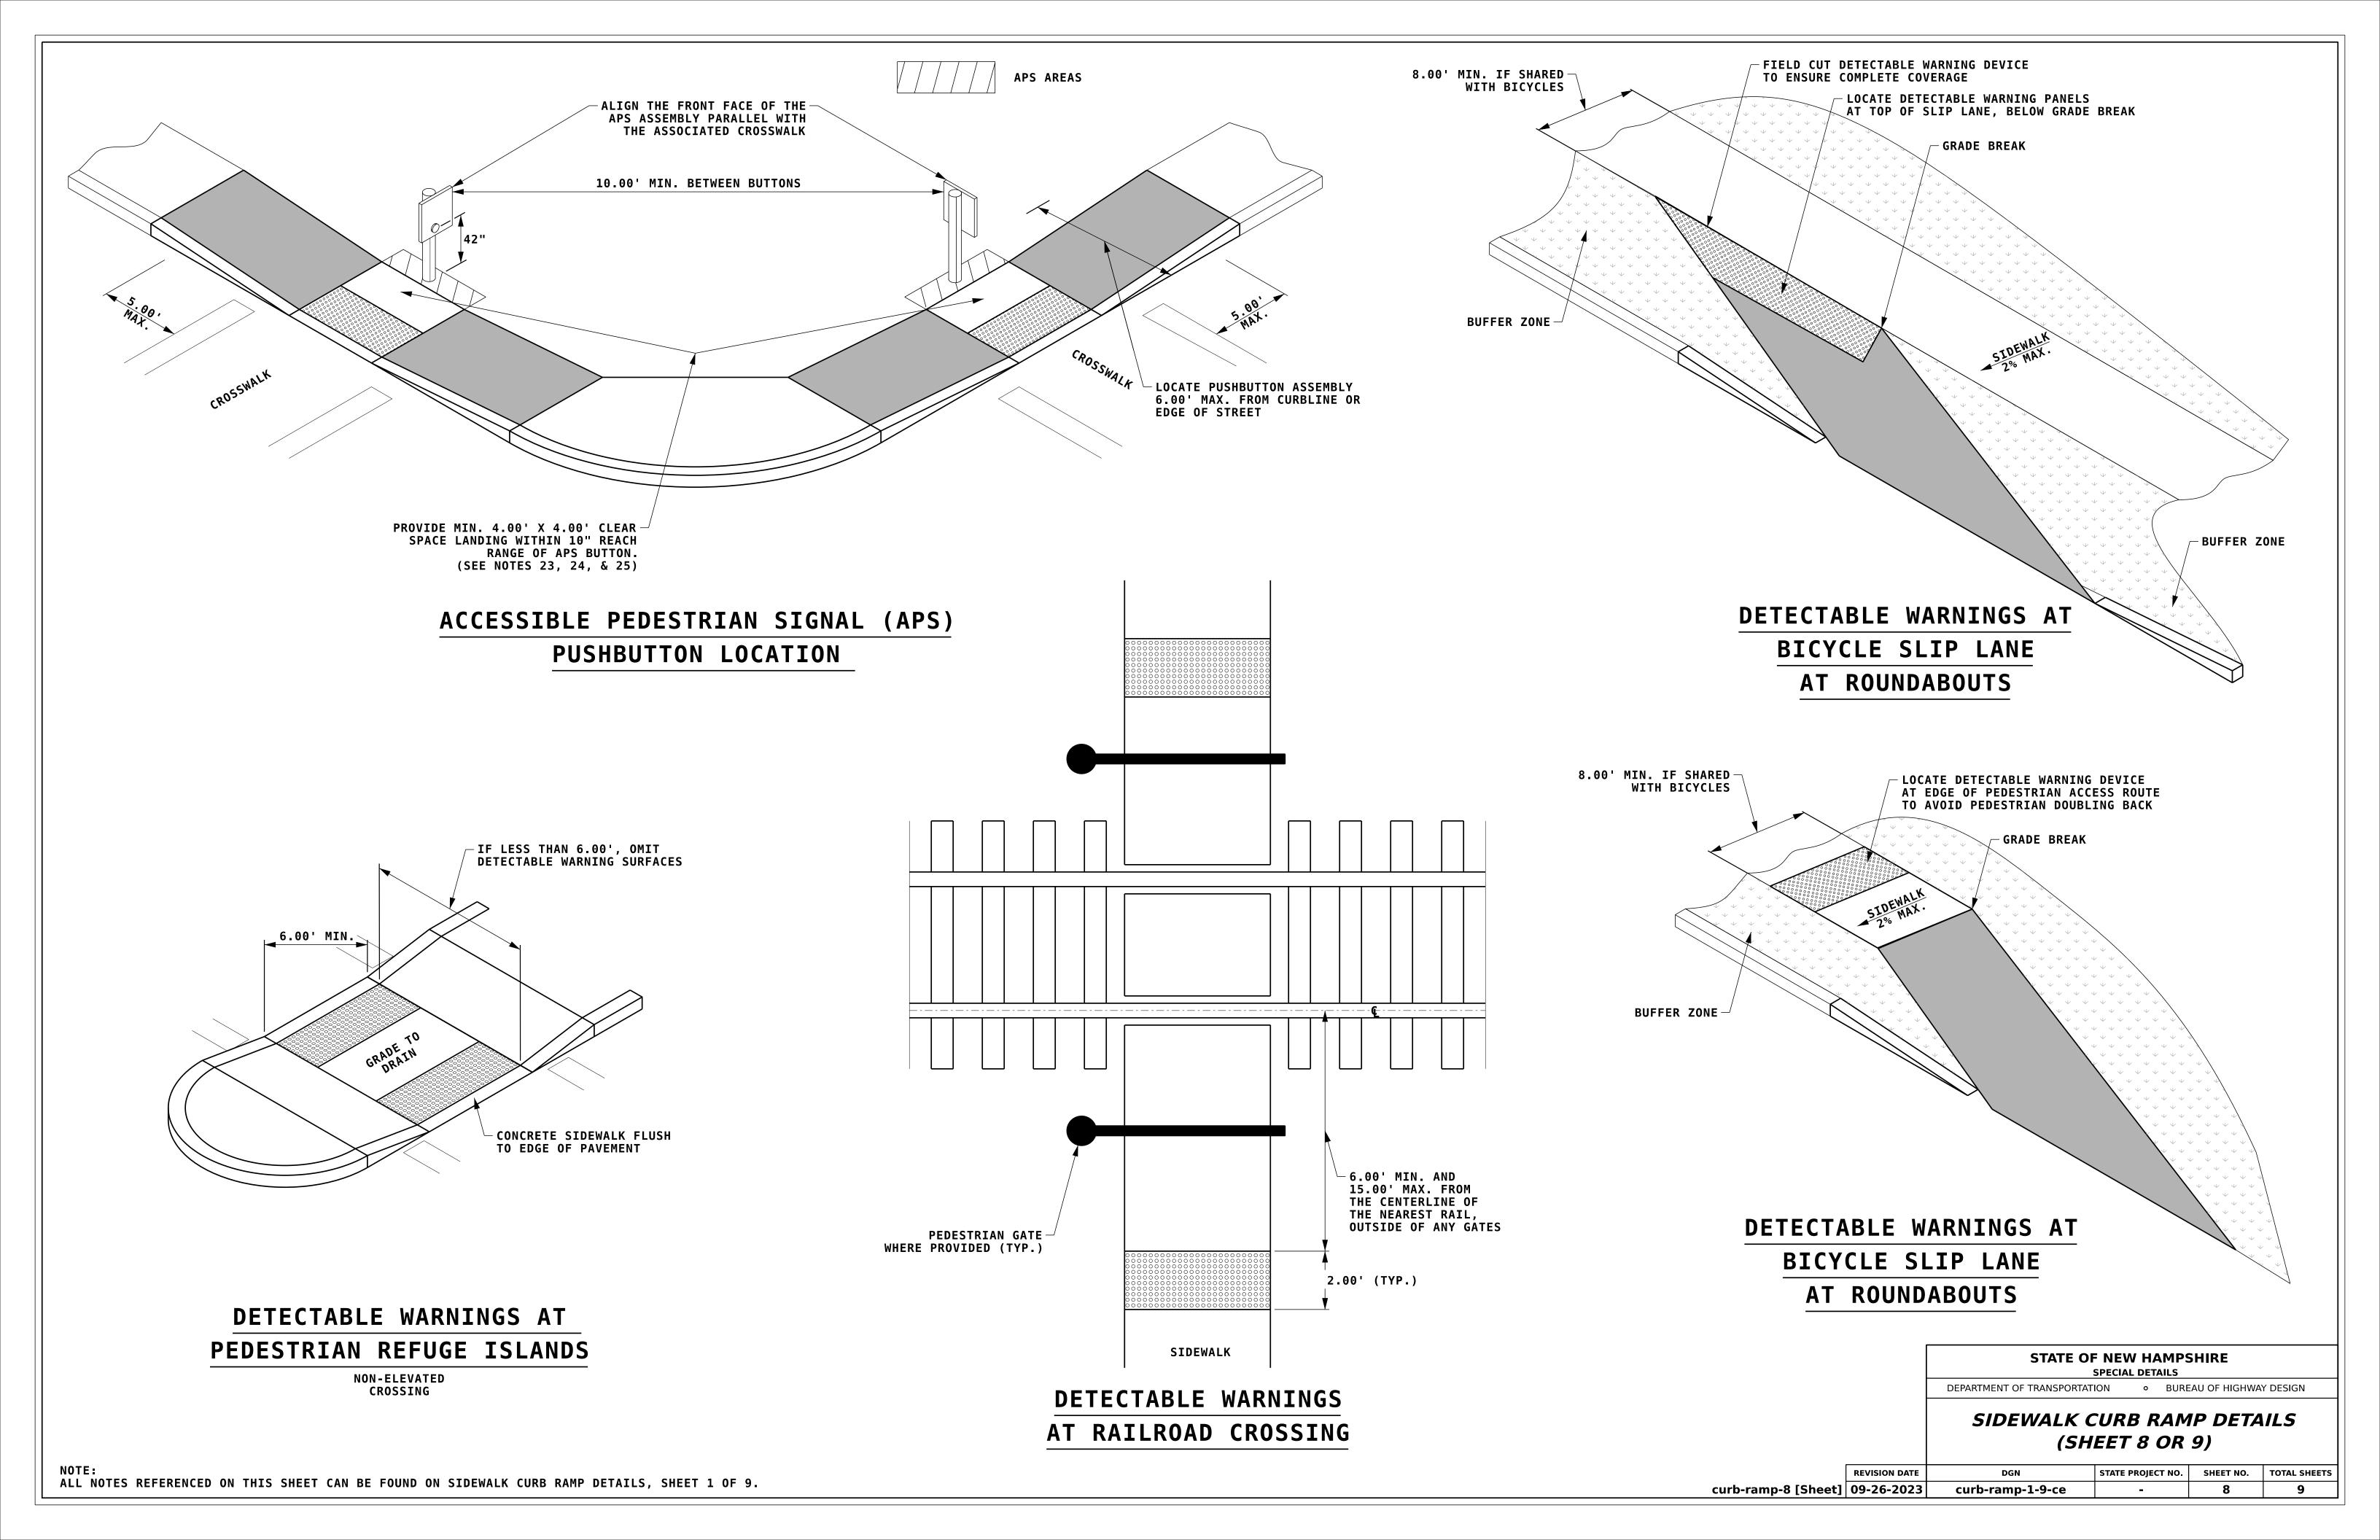


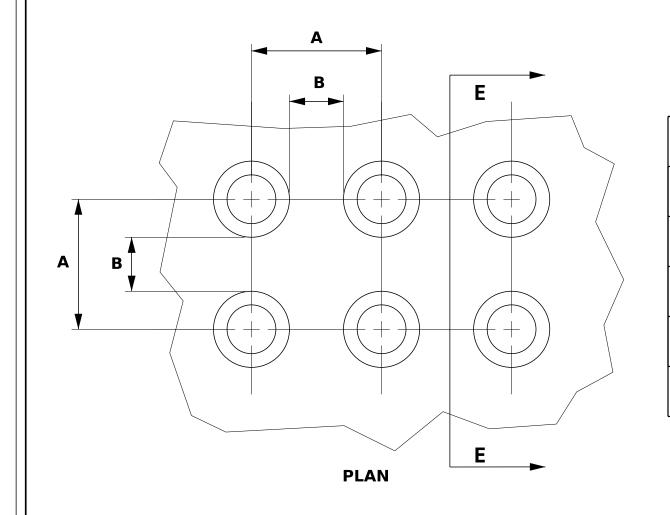

TRUNCATED DOME DIMENSIONS			
DIM.	MIN. (IN)	MAX. (IN)	
A	1.6"	2.4"	
В	0.65"	1.5"	
С	50% - 65% OF D DIM.		
D	0.9"	1.4"	

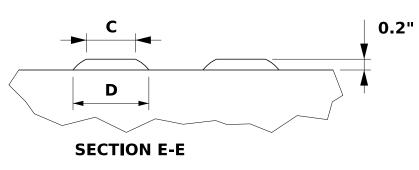


## DETECTABLE WARNING DEVICES (DWD) TRUNCATED DOME DETAILS

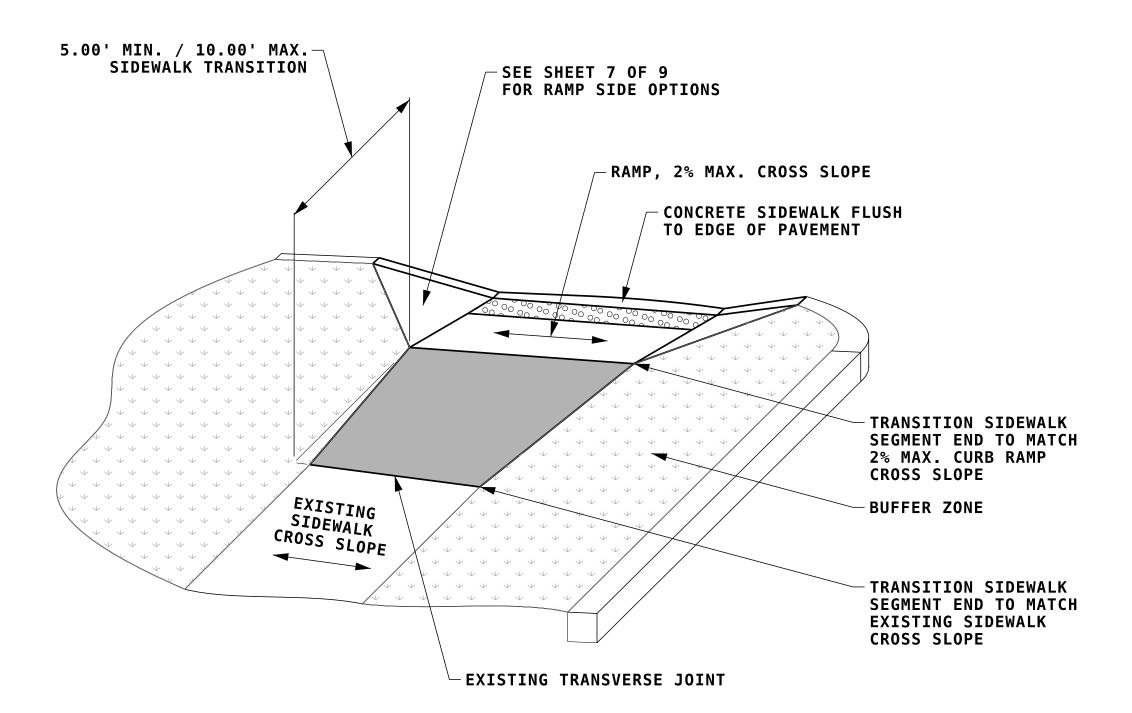


## TRANSITION BETWEEN CURB RAMP AND EXISTING SIDEWALK

USE FOR CROSS SLOPE AND WIDTH TRANSITIONS

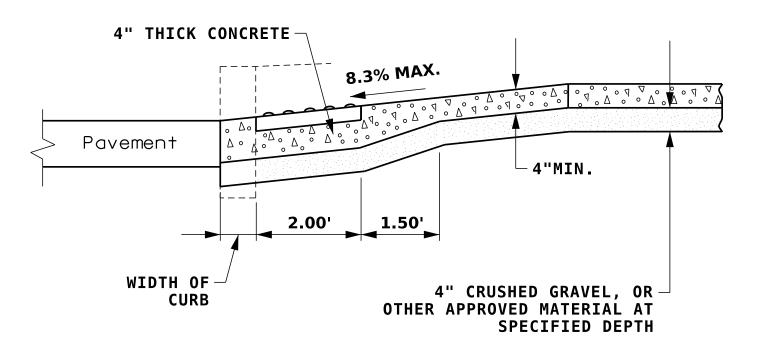


## **SECTION A-A**

SEE SHEET 7 OF 9

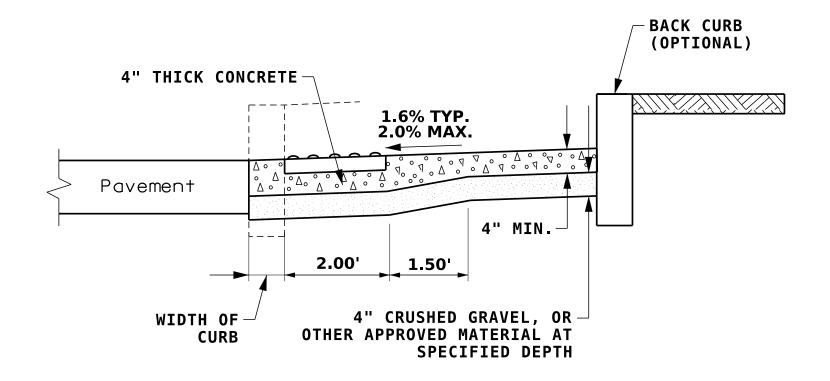


## **SECTION B-B**

SEE SHEET 7 OF 9

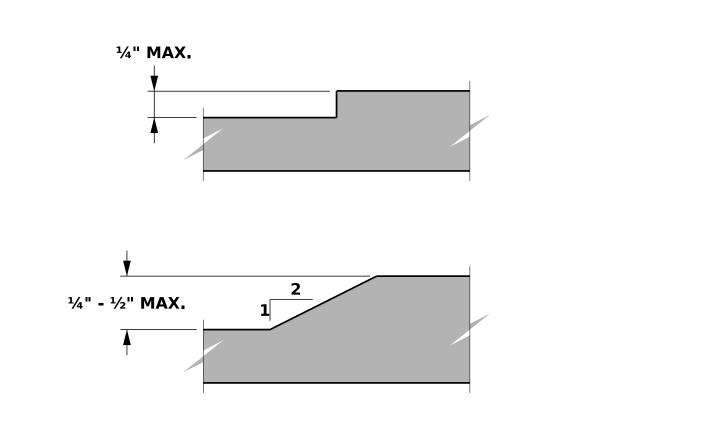


#### VERTICAL SURFACE DISCONTINUITIES

SEE NOTE 5

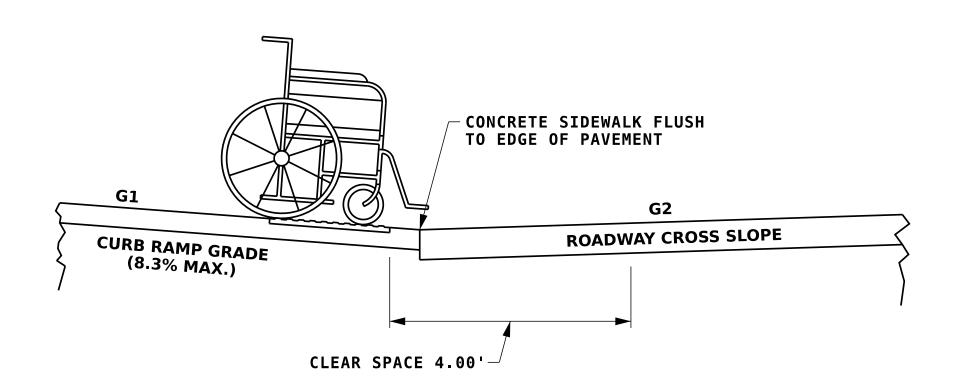

#### COUNTER SLOPE CONDITION 1


A = G2 - G1ALGEBRAIC DIFFERENCE (A) BETWEEN ROADWAY CROSS SLOPE AND CURB RAMP GRADE IS LESS THAN 13.3%.

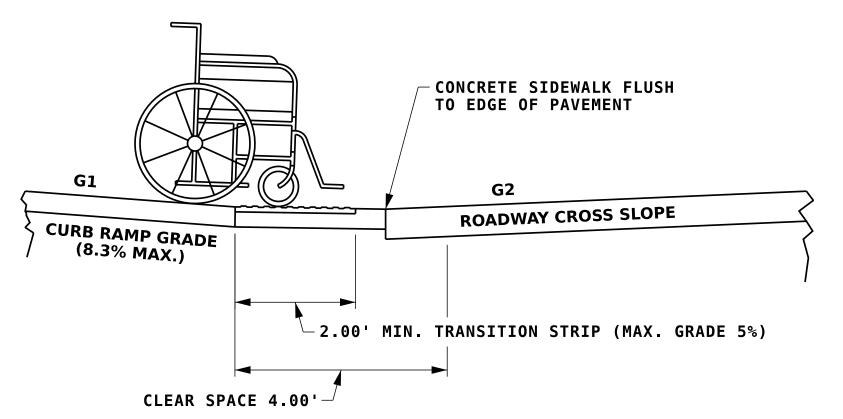

#### **COUNTER SLOPE CONDITION 2**

A = G2 - G1

ALGEBRAIC DIFFERENCE (A) BETWEEN ROADWAY SLOPE AND CURB RAMP GRADE IS GREATER THAN 13.3%. TRANSITION STRIP REQUIRED (MAX. GRADE 5%)

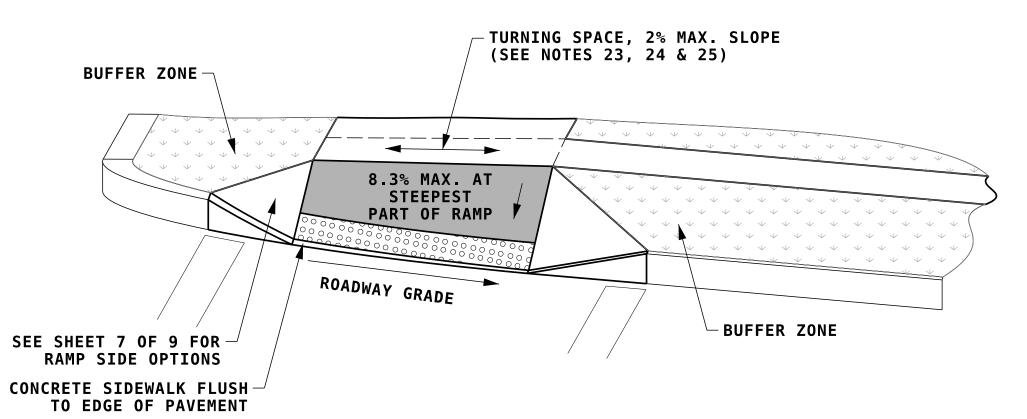

#### CURB RAMP CROSS SLOPE TRANSITION

REFER TO NOTE 20 FOR CROSS SLOPE REQUIREMENTS

STATE OF NEW HAMPSHIRE  SPECIAL DETAILS					
DEPARTMENT OF TRANSPORTATION	0	BUREAU OF HIGHWAY DESIGN			
SIDEWALK CURB RAMP DETAILS					

ALL NOTES REFERENCED ON THIS SHEET CAN BE FOUND ON SIDEWALK CURB RAMP DETAILS, SHEET 1 OF 9.

# (SHEET 9 OF 9)

REVISION DATE STATE PROJECT NO. | SHEET NO. | TOTAL SHEETS curb-ramp-9 [Sheet] | 09-26-2023 | curb-ramp-1-9-ce